



Contract No. 13/WSD/17

**Design, Build and Operate First Stage of Tseung Kwan O
Desalination Plant**

**Operation Phase Monthly EM&A Report No.18
(Period from 1 December to 31 December 2025)**

Document No.

| | | | | | | |
|-----------|---|--------------|---|----------------|---|----------------|
| Aurecon | / | P525597 | / | OPMEMAR18 | / | 2 |
| Publisher | | Project Code | | Sequential No. | | Revision Index |

| | |
|-----------|---|
| | Certified by: |
| Name | Toby WAN |
| Position | Environmental Team Leader |
| Signature |  |
| Date: | 22 January 2026 |

REVISION HISTORY

| REV. | DESCRIPTION OF MODIFICATION | DATE |
|------|-----------------------------|-----------|
| 1. | 1 st Issue | 22/1/2026 |
| 2. | 2 nd Issue | 26/1/2026 |

CONTENTS

| | |
|--|----|
| Executive Summary | 1 |
| 1. Basic Contract Information | 3 |
| 2. Water Quality | 8 |
| 3. Waste | 12 |
| 4. Landfill Gas Monitoring | 13 |
| 5. Landscape | 16 |
| 6. Ecology (Coral Monitoring) | 17 |
| 7. Ecology (Fishery Monitoring) | 19 |
| 8. Summary of Exceedance, Complaints, Notification of Summons and Prosecutions | 21 |
| 9. EM&A Site Inspection | 23 |
| 10. Future Key Issues | 24 |
| 11. Conclusions and Recommendations | 25 |

| | |
|------------|--|
| Appendix A | Overview of Desalination Plant in Tseung Kwan O |
| Appendix B | Summary of Implementation Status of Environmental Mitigation |
| Appendix C | Impact Monitoring Schedule |
| Appendix D | Event/Action Plan |
| Appendix E | Landfill Gas Equipment Calibration Certificate (Not Used) |
| Appendix F | Landfill Gas Monitoring Data (Not Used) |
| Appendix G | Waste Flow Table |
| Appendix H | Ecology Survey Report (Not Used) |
| Appendix I | Site Inspection Proforma |
| Appendix J | Complaint Log |

EXECUTIVE SUMMARY

INTRODUCTION

- A1. The Project, Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant (TKODP), is a Designated Project under the Environmental Impact Assessment Ordinance (Cap. 499) (EIAO) and is currently governed by a Further Environmental Permit (EP No. FEP - 01/503/2015/B) for the operation phase of the Contract.
- A2. In accordance with the Environmental Monitoring and Audit (EM&A) Manual for the Contract, EM&A works for marine water quality, waste management and ecology should be carried out by Environmental Team (ET), Aurecon Hong Kong Limited (Aurecon), during the Tseung Kwan O Desalination Plant.
- A3. The TKODP commenced the operation stage on 1 July 2024. This is the 18th Operation Phase Monthly EM&A Report, prepared by Aurecon, for the Contract summarizing the monitoring results and audit findings of the EM&A programme at and around Tseung Kwan O Area 137 (TKO 137) during operation of Tseung Kwan O Desalination Plant in December 2025.
- A4. The EM&A programme for this contract has covered environmental monitoring on water quality and Contractor's environmental performance auditing in the aspects of dust, landfill gas, water quality, waste management, Landscape and Visual and Ecology.

SUMMARY OF EXCEEDANCE & INVESTIGATION & FOLLOW-UP

WATER QUALITY MONITORING

- A5. The first-year operation phase marine water quality monitoring was completed on 30 June 2025. No marine water quality monitoring was conducted during the reporting period.
- A6. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, continuous monitoring of effluent quality was discontinued and replaced with effluent water monitoring in compliance with discharge license requirements starting from 15 August 2025.

ECOLOGY IMPACT MONITORING

- A7. No Coral monitoring was conducted during the reporting period.
- A8. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, coral monitoring will be conducted on a quarterly basis starting from August 2025.
- A9. Operation phase fishery monitoring for wet season 2025 was carried out on 16 and 23 August 2025. Details of the survey report were included in the October Monthly Report.

LANDFILL GAS MONITORING

- A10. In this reporting period, no landfill gas monitoring was conducted.
- A11. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, landfill gas monitoring will be conducted on a six-month basis starting from August 2025.

WEEKLY SITE INSPECTIONS

- A12. In this reporting period, bi-weekly site inspections were carried out by ET on 11 and 22 December 2025. Joint site inspections of the operation work by ET and IEC were carried out on 22 December 2025 to audit the mitigation measures implementation status.
- A13. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, site inspection will be conducted on a bi-weekly basis starting from 15 August 2025.

COMPLAINT HANDLING AND PROSECUTION

- A14. No environmental complaints, notification of summons and prosecution were received in the reporting period.

REPORTING CHANGE

- A15. According to the contractor's information, the Anti-scalant dosage commenced on 10 April 2025. The Anti-scalant water quality test was also conducted starting from the same date.
- A16. The works of TKODP were substantially completed on 30 June 2024 and the plant commenced the operation phase on 1 July 2024. A Justification of Termination of the EM&A Programme for the Construction Phase was resubmitted to the EPD on 11 August 2025 and approved by the EPD on 15 August 2025.

A proposal to change the operation phase EM&A programme was submitted to the EPD on 11 August 2025 and approved by the EPD on 15 August 2025.

1. BASIC CONTRACT INFORMATION

BACKGROUND

- 1.1. The Acciona Agua, S.A. Trading, Jardine Engineering Corporation, Limited and China State Construction Engineering (Hong Kong) Limited as AJC Joint Venture (AJCJV) is contracted to carry out the Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant (TKODP) under Contract No. 13/WSD/17 (the Contract).
- 1.2. Aurecon Hong Kong Limited (Aurecon) is commissioned by AJCJV to undertake the Environmental Team (ET) services as required and/or implied, both explicitly and implicitly, in the Environmental Permit (EP), Environmental Impact Assessment Report (EIA Report) (Register No. AEIAR-192/2015) and Environmental Monitoring and Audit Manual (EM&A Manual) for the Contract; and to carry out the Environmental Monitoring and Audit (EM&A) programme in fulfillment of the EIA Report's EM&A requirements and Contract No. 13/WSD/17 Specification requirements.
- 1.3. Pursuant to the Environmental Impact Assessment Ordinance (EIAO), the Director of Environmental Protection granted the Environmental Permit (No. EP-01/503/2015/B) to Water Supplies Department (WSD); and granted the Further Environmental Permit (No. FEP-01/503/2015/B) to AJCJV for the Contract.

THE REPORTING SCOPE

- 1.4. This is the 18th Operation Phase Monthly EM&A Report for the Contract which summarizes the key findings of the EM&A programme of the Tseung Kwan O Desalination Plant Operation phase during the reporting period from 1 December to 31 December 2025.

CONTRACT ORGANIZATION

- 1.5. The Contract Organization structure for Operation Phase is presented in **Figure 1.1**.

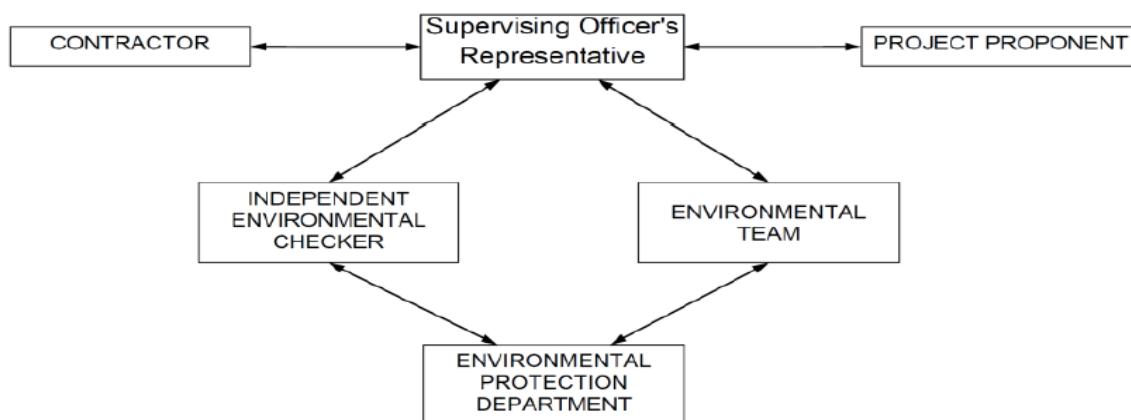


Figure 1.1 Contract Organization Chart

- 1.6. Contact details of the key personnel are presented in **Table 1.1** below:

Table 1.1 Contact Details of Key Personnel

| Party | Position | Name | Telephone no. |
|---|---|---------------------|---------------|
| Contract Proponent (Water Supplies Department) | SE/CM2 | Milton Law | 2634-3573 |
| Supervising Officer (Binnies Hong Kong Limited) | Project Manager | Augustine Li | 2608-7671 |
| | Senior Resident Engineer | Mason Pau | 6765-4131 |
| The Jardine Engineering Corporation, Limited, China State Construction Engineering (Hong Kong) Limited and Acciona Agua, S.A. Trading | Project Manager (Acting) | Arnes Parra, Victor | 6468-6710 |
| | Environmental Monitoring Manager | Brian Kam | 9456-9541 |
| | Environmental Monitoring Manager | Tommy Law | 6468-1782 |
| Aurecon Hong Kong Limited | Environmental Team Leader | Toby Wan | 9719-5422 |
| Lam Environmental Services Limited | Independent Environmental Checker (IEC) | Serena Shek | 6149-6683 |

SUMMARY OF OPERATION WORKS

- 1.7. Details of the major operation activities undertaken in this reporting period are shown below.
- 1.8. As informed by the Contractor, key activities carried out in this reporting period for the Contract included the followings:
 - Potable Water Production
- 1.9. The key environmental mitigation measures implemented for the Contract in this reporting period associated with the above operation works include:
 - Regularly monitoring of the effluent
 - Sorting and storage of general refuse and operation waste

1.10. Summary of the valid permits, licences, and/or notifications on environmental protection for this Contract is presented in **Table 1.2**.

Table 1.2 Summary of the Status of Valid Environmental Licence, Notification, Permit and Documentations

| Permit/ Licences | Valid Period | | Status | Remark |
|---|-------------------------|-------------------------|--------|--|
| | From | To | | |
| Environmental Permit | | | | |
| EP-503/2015/B | Throughout the Contract | | Valid | -Issued on 3 April 2024 |
| FEP 01/503/2015/B | - | Throughout the Contract | Valid | -Issued on 3 April 2024 |
| Billing Account for Disposal | | | | |
| 7036276 | Throughout the Contract | | Valid | - |
| Sludge (Special Waste) Disposal (Admission Ticket) | | | | |
| 115399 | 23/08/2025 | 22/02/2026 | Valid | - |
| Chemical Waste Producer Registration | | | | |
| 5213-839-A2987-01 | Throughout the Contract | | Valid | - |
| Wastewater Discharge Licence (Land and Marine works) | | | | |
| WT00044188-2023 | 16/06/2023 | 30/06/2028 | Valid | <ul style="list-style-type: none"> - For Plant T&C and operation. - Variation sampling point S.P.1 is approved by the EPD on 25 June 2024 (EPD ref.: EP640/W3/D1358/46 2874). EPD advise that we can use the current discharge license for the anti-scalant dosing and discharge limit. They agreed that the report can show the 5PPM is the lowest detection limit. The variation of application was withdrawn on 13 Dec 2024. |

1.11. The status for all environmental aspects is presented in **Table 1.3**.

Table 1.3 Summary of Status for Key Environmental Aspects under the EM&A Manual

| Parameters | Status |
|---|---|
| Water Quality | |
| Baseline Monitoring under EM&A Manual | The baseline water quality monitoring was conducted between 12 May 2020 to 6 Jun 2020. |
| Operation phase Marine Water Quality Monitoring | Completed on 30 June 2025 |
| Continuous Monitoring of Effluent Quality Monitoring | According to the approved proposal to change the operation phase EM&A programme for the 2 nd to 10 th years, continuous monitoring of effluent quality was discontinued and replaced with effluent water monitoring in compliance with discharge license requirements starting from 15 August 2025. |
| Monthly Effluent Quality Monitoring (Discharge License Requirement) | On-going |
| Waste Management | |
| Mitigation Measures in Waste Management Plan | On-going |
| Landfill Gas | |
| Monthly Monitoring for buildings, manholes and utility pits within the Project Site and along the fresh water mains | According to the approved proposal to change the operation phase EM&A programme for the 2 nd to 10 th years, landfill gas monitoring will be conducted on a six-month basis starting from August 2025. |
| Six-month Basis Monitoring for buildings, manholes and utility pits within the Project Site and along the fresh water mains | On-going |
| Ecology (Coral) | |
| Operation phase Regular Coral Monitoring (Monthly) | According to the approved proposal to change the operation phase EM&A programme for the 2 nd to 10 th years, coral monitoring will be conducted on a quarterly basis starting from August 2025. |
| Operation phase Regular Coral Monitoring (Quarterly) | On-going |
| Ecology (Fishery) | |
| Operation phase Regular Fishery Monitoring (Seasonally) | On-going |

| Parameters | Status |
|---|---|
| Landscape | |
| Weekly Operation phase Landscape and Visual Site Inspection | According to the approved proposal to change the operation phase EM&A programme for the 2 nd to 10 th years, site inspection will be conducted on a bi-weekly basis starting from 15 August 2025. |
| Bi-Weekly Operation phase Landscape and Visual Site Inspection | On-going |
| Environmental Audit | |
| Weekly Site Inspection covering Measures of Air Quality, Water Quality, Waste, Ecological Quality, Fisheries, Landscape and Visual | According to the approved proposal to change the operation phase EM&A programme for the 2 nd to 10 th years, site inspection will be conducted on a bi-weekly basis starting from 15 August 2025. |
| Bi-Weekly Site Inspection covering Measures of Air Quality, Water Quality, Waste, Ecological Quality, Fisheries, Landscape and Visual | On-going |

- 1.12. Other than the EM&A work by ET, environmental briefings, trainings, and regular environmental management meetings were conducted, in order to enhance environmental awareness and closely monitor the environmental performance of the contractors.
- 1.13. The EM&A programme has been implemented in accordance with the recommendations presented in the approved EIA Report and the EM&A Manual. A summary of implementation status of the environmental mitigation measures for the operation phase of the Contract during the reporting period is provided in **Appendix B**.

2. WATER QUALITY

- 2.1. In accordance with the recommendations of the EIA, water quality monitoring is required during operation phase. The following Section provides details of the water quality monitoring to be undertaken by the Environmental Team (ET) to verify the distance of sediment and brine plume dispersion and to identify whether the potential exists for any indirect impacts to occur to ecological sensitive receivers.
- 2.2. The first-year operation phase marine water quality monitoring was completed on 30 June 2025. No marine water quality monitoring was conducted during the reporting period.
- 2.3. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th years, continuous monitoring of effluent quality was discontinued and replaced with effluent water monitoring in compliance with discharge license requirements starting from 15 August 2025.

WATER DISCHARGE LICENSE (WT00044188-2023 PART 1)

- 2.4. In accordance with the WT00044188-2023 Part 1, the sampling should be followed the specified frequency, and the parameters of the sample should not be exceeded the limit stated as the water discharge license. Details derived limit levels for water quality are presented in **Table 2.1**.

Table 2.1 Derived Limit Levels for Water Quality


| Parameters | Limit |
|---------------------------------------|------------|
| Monitoring of Effluent Quality | |
| Flow Rate in m ³ /day | 216841 |
| Temperature in °C | Maximum 40 |
| Salinity | 71347 |
| SS in mg/L | 13 |
| pH | 6-9 |
| Iron in mg/L | 0.6 |
| Total residual chlorine in mg/L | 0.1 |
| Total Inorganic Nitrogen in mg/L | 2 |
| Total Phosphorous in mg/L | 1 |
| Sodium Metabisulphite in mg/L | 0.5 |
| Anti scalant in mg/L* | 2.2 |

*Remark:

1. Anti-scalant water quality testing will only be conducted whenever anti-scalant dosage is adopted.

MONITORING LOCATION

2.5. In accordance with the discharge license, the Monitoring shall be sampling at Brine Outfall Shaft.

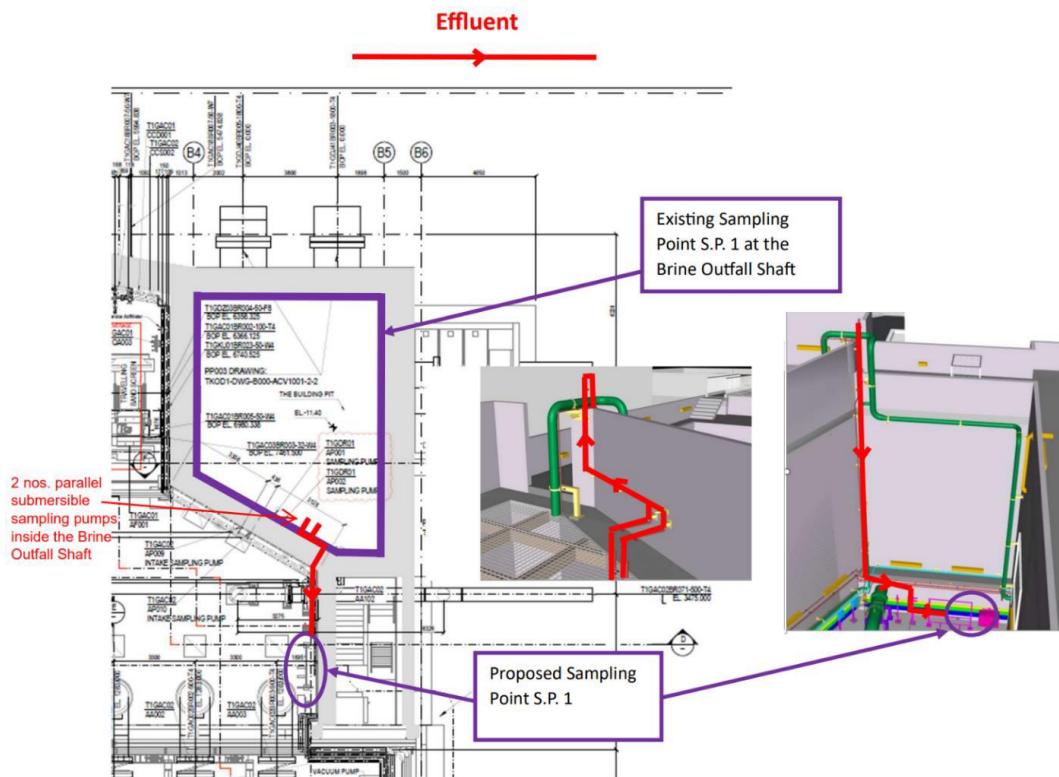

MONITORING RESULTS AND OBSERVATIONS

2.6. According to the contractor's information, the Anti-scalant dosage commenced on 10 April 2025. The Anti-scalant water quality test was also conducted starting from the same date.

2.7. The weekly In-situ monitoring was carried out on 4, 11, 18 and 25 November 2025 and the monthly laboratory measurement was carried out on 3 November 2025.

2.8. No exceedance of the results was obtained during the reporting period. The detail results are summarized in **Table 2.2, 2.3 and 2.4**.

Table 2.2 Summary of In-situ Results for Discharge License (Weekly)

| Date | Determinant | Results | Duplicate | Average |
|-------------|--------------------------------|---------|-----------|---------|
| 4 Dec 2025 | Temp (°C) | 23.1 | 23.5 | 23.3 |
| | Salinity (ppm) | 56840 | 56250 | 56545 |
| | pH | 7.6 | 8.0 | 7.8 |
| | Total Residual Chlorine (mg/L) | 0.04 | 0.05 | 0.05 |
| 11 Dec 2025 | Temp (°C) | 23.1 | 22.1 | 22.6 |
| | Salinity (ppm) | 57380 | 57340 | 57360 |
| | pH | 7.6 | 7.9 | 7.8 |
| | Total Residual Chlorine (mg/L) | 0.03 | 0.05 | 0.04 |

| | | | | |
|-------------|--------------------------------|-------|-------|-------|
| 18 Dec 2025 | Temp (°C) | 22.0 | 22.4 | 22.2 |
| | Salinity (ppm) | 57070 | 57065 | 57068 |
| | pH | 7.8 | 7.5 | 7.7 |
| | Total Residual Chlorine (mg/L) | 0.05 | 0.04 | 0.05 |
| 25 Dec 2025 | Temp (°C) | 20.4 | 20.7 | 20.6 |
| | Salinity (ppm) | 56800 | 56790 | 56795 |
| | pH | 8.0 | 7.9 | 7.95 |
| | Total Residual Chlorine (mg/L) | 0.04 | 0.03 | 0.04 |

Table 2.3 Summary of Lab Results for Discharge License (Monthly)

| Date | Determinant | Results |
|------------|---|--------------------|
| 8 Dec 2025 | Flow Rate (m ³ /day) | Shown in Table 2.4 |
| | Suspended Solids (mg/L) | <2 |
| | Total Inorganic Nitrogen (mg/L) | 0.14 |
| | Total Phosphorous (mg/L) | <0.01 |
| | Iron (mg/L) | <0.1 |
| | Sodium Metabisulphite (mg/L) ¹ | <2 |
| | ACUMER 4035 (mg/L) ² | N/A |

Remark:

- As confirmed by various laboratories in Hong Kong, the lowest detection limit for Sodium Metabisulphite is <2 mg/L. Due to the limitation of the laboratory, the lowest result for Sodium Metabisulphite will only be shown as < 2 mg/L.
- As discussed and agreed with EPD on 12 December 2024, since the lowest detection limit of anti-scalant chemical(s) (ACUMER 4035) in Hong Kong is 5 mg/L due to the limitation of laboratory, the lowest measurement result of anti-scalant chemical(s) (ACUMER 4035) will only be shown as < 5 mg/L.

Table 2.4 Summary of Daily Flow Rate of Reporting Period

| Date | Outfall (m ³ /day) |
|-----------|-------------------------------|
| 1-Dec-25 | 51,413.63 |
| 2-Dec-25 | 54,358.02 |
| 3-Dec-25 | 53,028.56 |
| 4-Dec-25 | 55,177.71 |
| 5-Dec-25 | 55,030.43 |
| 6-Dec-25 | 52,919.05 |
| 7-Dec-25 | 52,765.80 |
| 8-Dec-25 | 54,447.18 |
| 9-Dec-25 | 52,882.13 |
| 10-Dec-25 | 52,813.51 |
| 11-Dec-25 | 54,735.76 |
| 12-Dec-25 | 52,911.11 |
| 13-Dec-25 | 52,794.09 |
| 14-Dec-25 | 52,870.70 |
| 15-Dec-25 | 54,096.43 |
| 16-Dec-25 | 53,104.70 |
| 17-Dec-25 | 53,094.81 |
| 18-Dec-25 | 54,068.45 |
| 19-Dec-25 | 54,224.86 |
| 20-Dec-25 | 52,664.79 |
| 21-Dec-25 | 54,230.00 |
| 22-Dec-25 | 52,635.37 |
| 23-Dec-25 | 54,008.46 |

| | |
|-----------|-----------|
| 24-Dec-25 | 52,354.58 |
| 25-Dec-25 | 55,436.00 |
| 26-Dec-25 | 52,494.79 |
| 27-Dec-25 | 53,773.97 |
| 28-Dec-25 | 53,018.34 |
| 29-Dec-25 | 52,736.43 |
| 30-Dec-25 | 55,177.09 |
| 31-Dec-25 | 55,330.13 |

3. WASTE

3.1. The waste generated from this Contract includes inert construction and demolition (C&D) materials, and non-inert C&D materials. Non-inert C&D materials are made up of general refuse, vegetative wastes and recyclable wastes such as plastics and paper/cardboard packaging waste. Steel materials generated from the Contract are also grouped into non-inert C&D materials as the materials were not disposed of with other inert C&D materials. With reference to relevant handling records and trip tickets of this Contract, the quantities of different types of waste generated in the reporting month are summarized in **Table 3.1**. Details of cumulative waste management data are presented as a waste flow table in **Appendix G**.

Table 3.1 Quantities of Waste Generated from the Contract during the reporting period

| Reporting Month | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|-----------------|--|-------------------------------------|------------------------|--------------------------|-------------------------|---------------|---|-----------------------------|-------------------------|----------------|------------------------------|
| | Total Quantity Generated | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper / cardboard packaging | Plastics ⁽¹⁾ | Chemical Waste | Others, e.g., general refuse |
| | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) |
| Dec 2025 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 70.660 |

Notes: (1) Plastics refer to plastic bottles / containers, plastic sheets / foam from packaging material

3.2. No dewater sludge was generated by the operation in the reporting period.

4. LANDFILL GAS MONITORING

MONITORING REQUIREMENT

- 4.1. In accordance with Section 11 of the EM&A Manual, monthly monitoring of landfill gas is required for the first year of operation at buildings within the Project Site and consultation zone. Part of the desalination plant and the indicative area of natural slope mitigation works fall within the SENT Landfill Extension Consultation Zone; and part of the 1,200 mm diameter freshwater mains along Wan Po Road falls within the SENT Landfill and SENT Landfill Extension Consultation Zones, TKO Stage II/III Restored Landfill and TKO Stage I Restored Landfill Consultation Zones.
- 4.2. Routine monitoring is required at buildings within the Project Site and consultation zones. The monitoring frequency will be monthly for the first year of operation.
- 4.3. For the manholes and utility pits within the Project Site and along the fresh water mains, each manhole/ utility pit should be monitored with two measurements (at mid depth and base). Each measurement should be monitored for a minimum of 10 minutes. A steady reading and peak reading should be recorded at each manhole/ utility pit and for each measurement.
- 4.4. Monitoring oxygen, methane, carbon dioxide and barometric pressure would be performed monthly during the operation phase.

MONITORING LOCATION

4.5. The area required to be monitored for landfill gas in the reporting period is shown in **Figure 4.1, Figure 4.2 and Figure 4.3**.

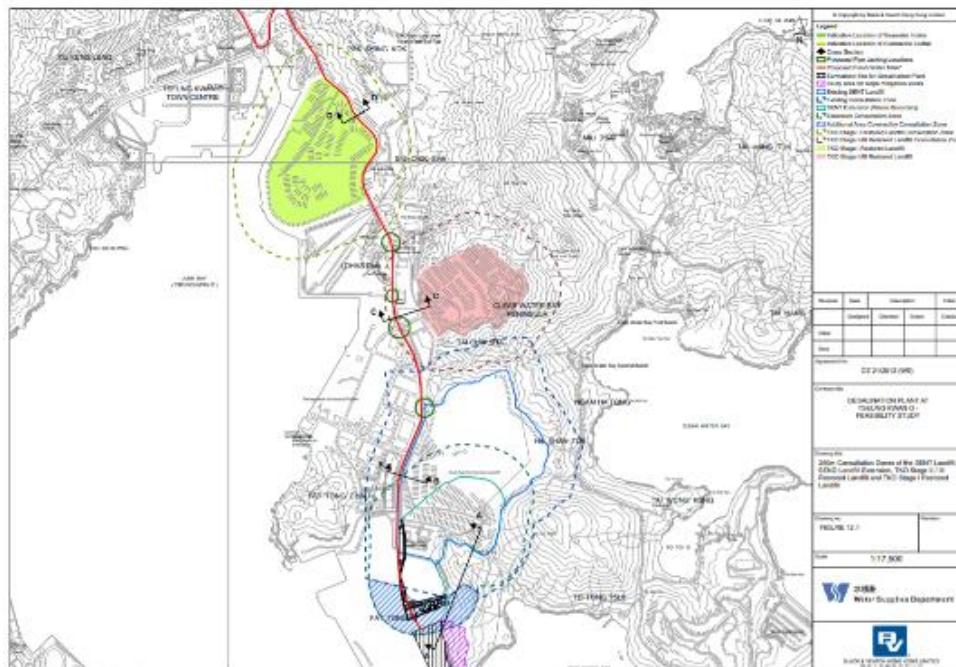


Figure 4.1 Overview of the SENT Extension Consultation Zone and the Contract Site Area

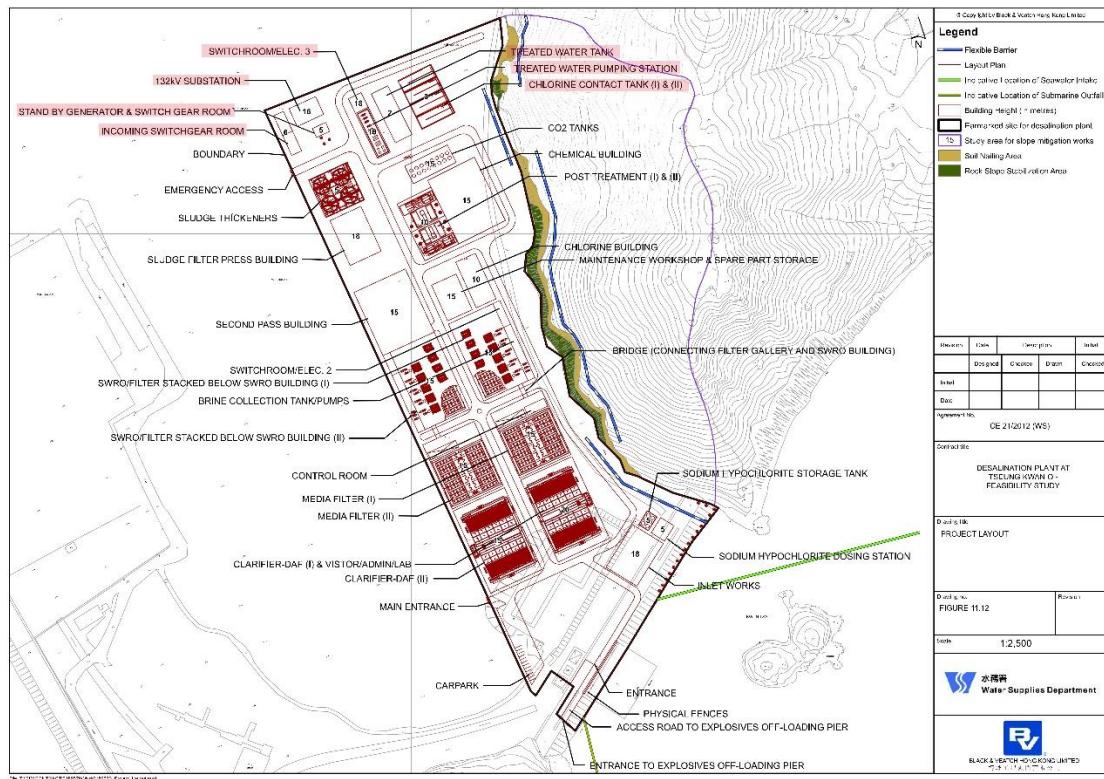


Figure 4.2 Landfill Gas Monitoring Location For Building

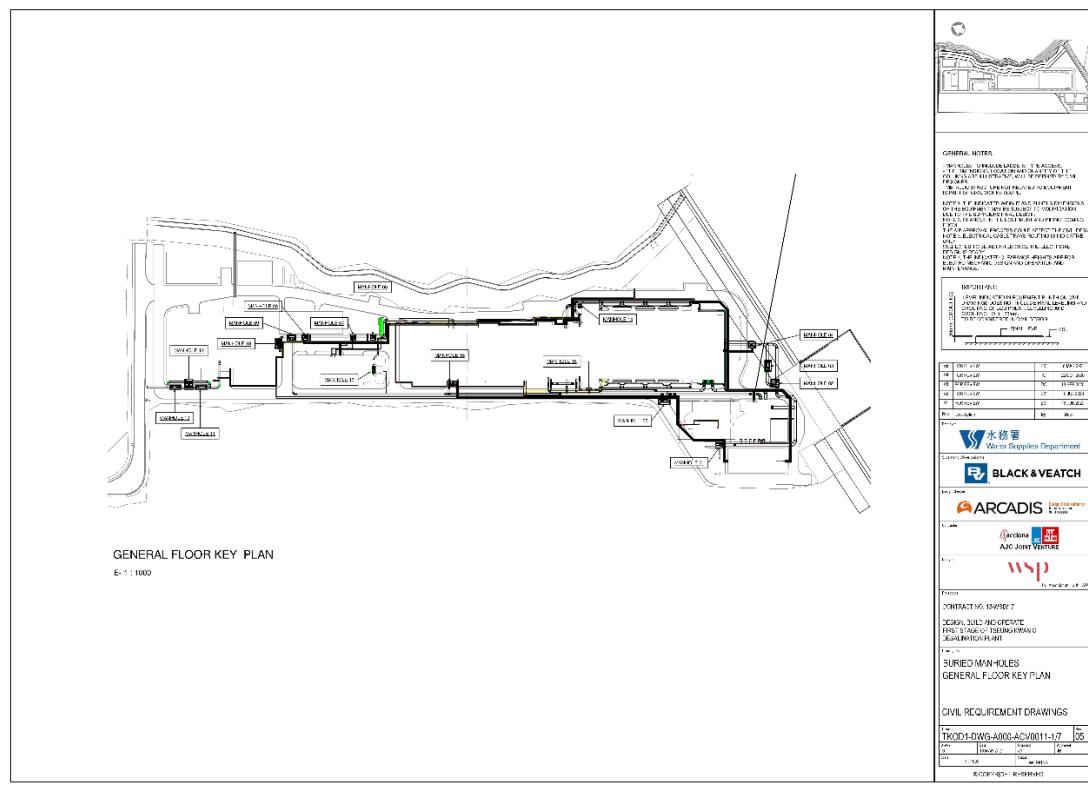


Figure 4.3 Landfill Gas Monitoring Location For Manholes/Pits

MONITORING PARAMETERS

4.6. The landfill gas monitoring parameters and the action and limit level are summarized in **Table 4.1**.

Table 4.1 Action and Limit Level for Landfill Gas Monitoring Equipment

| Parameters | Action Level | Limit Level |
|-----------------------------------|-----------------------|-----------------------|
| Oxygen (O ₂) | <19% O ₂ | <19% O ₂ |
| Methane (CH ₄) | >10% LEL | >20% LEL |
| Carbon Dioxide (CO ₂) | >0.5% CO ₂ | >1.5% CO ₂ |

MONITORING EQUIPMENT

4.7. Landfill Gas monitoring was carried out using intrinsically-safe, portable multi-gas monitoring instruments. The gas monitoring equipment is:

- Complying with the Landfill Gas Hazard Assessment Guidance Note as intrinsically safe;
- Capable of continuous barometric pressure and gas pressure measurements;
- Normally operated in diffusion mode unless required for spot sampling, when it should be capable of operating by means of an aspirator or pump;
- Having low battery, fault and over range indication incorporated;
- Capable of storing monitoring data, and shall be capable of being downloaded directly;
- Measure in the following ranges:

| | |
|---------------------|--|
| methane | 0-100% LOWER EXPLOSION LIMIT (LEL) AND 0-100% v/v; |
| oxygen | 0-25% v/v; |
| carbon dioxide | 0-5% v/v; and |
| barometric pressure | mBar (absolute) |

- alarm (both audibly and visually) in the event that the concentrations of the following are exceeded:

| | |
|---------------------|-----------------|
| methane | >10% LEL; |
| oxygen | <19% |
| carbon dioxide | >0.5% by volume |
| barometric pressure | mBar (absolute) |

MONITORING RESULTS AND OBSERVATIONS

4.8. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, landfill gas monitoring will be conducted on a six-month basis starting from August 2025.

4.9. In this reporting period, no landfill gas monitoring was conducted during the reporting period.

5. LANDSCAPE

MONITORING REQUIREMENTS

5.1. In accordance with Section 8.1 of the EM&A Manual, weekly site audit shall be carried out by the ET including checking whether good site practices are being properly implemented by the Contractor and the extent of the works area within the Clear Water Bay Country Park should be checked by the ET during the weekly site audit.

SITE INSPECTION

5.2. Bi-Weekly site audit was carried out by the ET in the reporting month; all plants were observed to be in satisfactory condition in the reporting month.

5.3. If non-compliance were found during the operation phase, the actions in accordance with the Event and Action Plan will be carried out according to **Appendix D**.

6. ECOLOGY (CORAL MONITORING)

6.1. Under the approval conditions of the EIA Report for the Project, an EM&A programme on coral for the operation phase of the Project is recommended. Pursuant to these EIA approval conditions and Condition 3.1 of the EP and FEP, details of the regular coral monitoring programme have been proposed based on the baseline coral monitoring results in the Report on operation Baseline Coral Monitoring and Regular Coral Monitoring Methodology.

MONITORING LOCATION

6.2. In accordance with Appendix B Section 5.1 of the approved supplementary EM&A Manual, two indirect impact sites (C2 and C3) and one control site (C8) as shown in **Figure 6.1** should be monitored during the operation Phase. Operation coral survey should be conducted at the indirect impact and control sites. Ten selected hard coral colonies with similar species should be tagged at each of the control and indirect impact sites before commencement of the operation phase. Tagged hard coral colonies should be monitored in open waters during the operation phase.

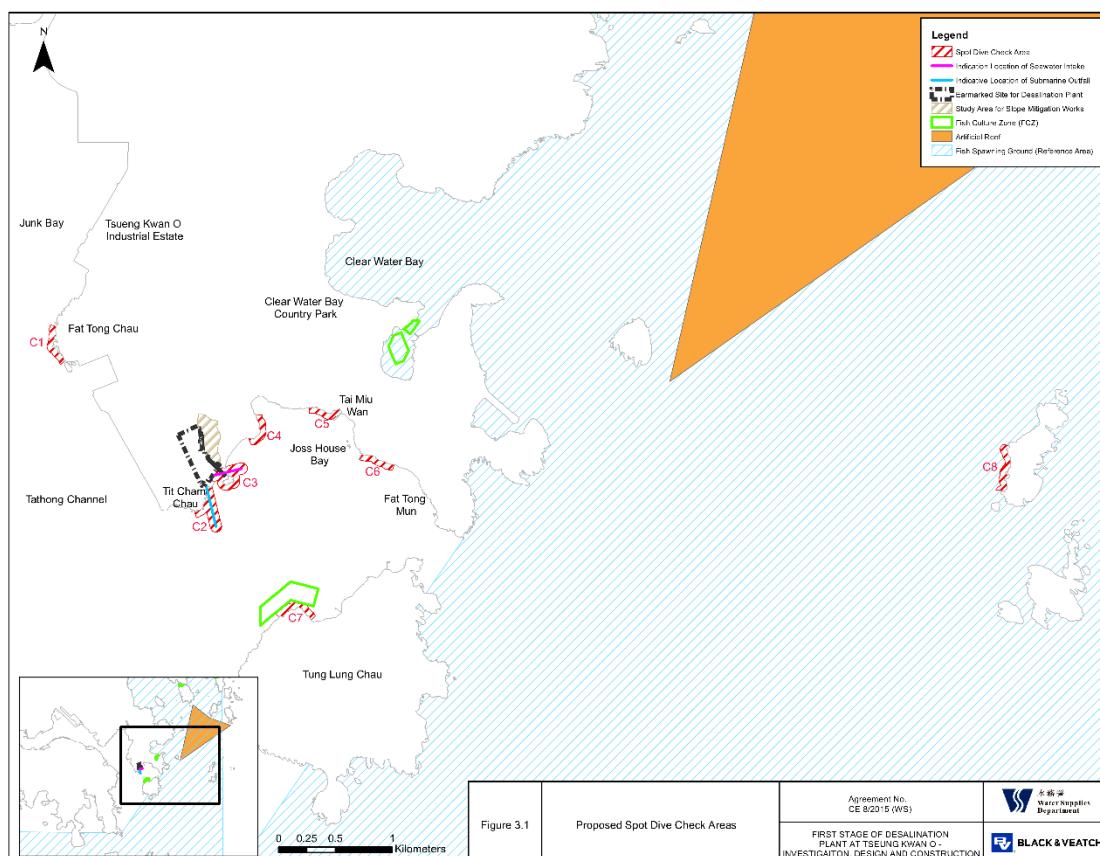


Figure 6.1 Spot Dive Check Areas Two Proposed Indirect Impact Sites (C2 and C3) and one control site (C8) during Operation Phase

ACTION AND LIMIT LEVELS

6.3. The Action and Limit Levels have been set based on the derivation criteria specified in the EM&A Manual. The Action/Limit Levels have been derived and are presented in **Table 6.1**.

Table 6.1 Action and Limit Level for Coral Monitoring Equipment

| Parameter | Action Level Definition | Limit Level Definition |
|-----------|--|---|
| Mortality | If during Impact Monitoring a 15% increase in the percentage of partial mortality on the corals occurs at more than 20% of the tagged indirect impact site coral colonies that is not recorded on the tagged corals at the control site, then the Action Level is exceeded | If during Impact Monitoring a 25% increase in the percentage of partial mortality on the corals occurs at more than 20% of the tagged indirect impact site coral colonies that is not recorded on the tagged corals at the control site, then the Limit Level is exceeded |

Note: If the defined Action Level or Limit Level for coral monitoring is exceeded, the actions as set out in **Appendix D, Table D3** will be implemented.

6.4. If non-compliance were found during the operation works, the actions in accordance with the Event and Action Plan will be carried out according to **Appendix D**.

MONITORING FREQUENCY

6.5. Operation phase coral monitoring shall be monitored once per month as the requirement of the first year of operational phase.

MONITORING RESULT AND OBSERVATION

6.6. No coral monitoring was conducted during the reporting period.

6.7. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th year, coral monitoring will be conducted on a quarterly basis starting from August 2025.

7. ECOLOGY (FISHERY MONITORING)

7.1. The purpose of the operation phase regular fisheries monitoring programme is to monitor the potential impacts on fisheries resources in the vicinity of the project site. Apart from the regular fisheries monitoring programme, a water quality monitoring programme in addition to the water quality monitoring programme in the approved EM&A Manual is also described in Section 2.4 to (i) provide supplementary information in the interpretation of the findings of the fisheries monitoring and (ii) assist the monitoring of the potential impact on the Tung Lung Chau Fish Culture Zone (FCZ) in Joss House Bay.

MONITORING LOCATION

7.2. In accordance with Section 2.3 of the approved Methodology Paper on Regular Fisheries Monitoring, it is recommended to set up six (6) fisheries monitoring locations in Joss House Bay and its vicinity to monitor the fisheries resources.

7.3. Two (2) sampling locations are set up in close proximity of the direct footprint of the proposed submarine utilities around TKO Area 137. These sampling locations represent the potential Project impact zones (i.e. areas at and in close proximity to the footprint of the proposed submarine utilities that will be directly affected by the Project works).

7.4. Two (2) gradient locations are proposed between the proposed submarine utilities and Tung Lung Chau FCZ to assist in the interpretation and identification of any potential fisheries impact in the vicinity of the FCZ.

7.5. Two (2) reference locations are proposed in the outer Joss House Bay between the waters of Tung Lung Chau and Fat Tong Mun. These reference locations are further away and will not be affected by the Project discharge (based on the EIA prediction) and will serve as control stations. Any significant fisheries impact identified at the reference locations should be caused by other natural factors or non-Project activities. The trends of fisheries conditions recorded in the reference locations will be used to assist in the interpretation of the trends of fisheries impact identified in the impact and gradient locations.

7.6. The coordinates of the proposed monitoring locations are shown in **Figure 7.1**.

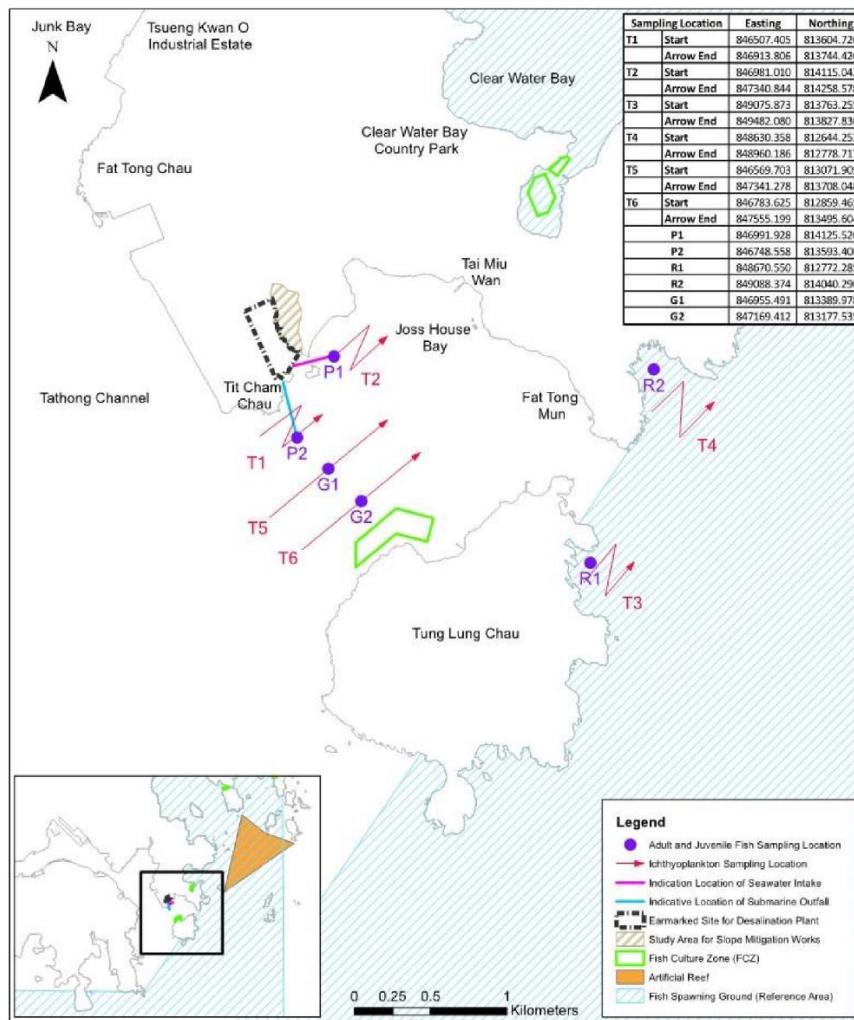


Figure 7.1 Monitoring Location of Regular Fishery Monitoring during Operation Phase

MONITORING FREQUENCY

7.7. Operation phase fishery monitoring shall be carried out 2 times in wet season (April to October) and 2 times in dry season (December to March) to examine the following:

- Fish species composition;
- Abundance: number of fish captured;
- Diversity of fish resources: species diversity and evenness;
- Size: range of total length; Biomass in weight; and
- Values of catches of commercial species: catch per unit effort (CPUE) and yield per unit effort (YPUE).

MONITORING RESULT AND OBSERVATION

7.8. Operation phase fishery monitoring for wet season 2025 was carried out on 16 and 23 August 2025. Details of the survey report were included in the October Monthly Report.

8. SUMMARY OF EXCEEDANCE, COMPLAINTS, NOTIFICATION OF SUMMONS AND PROSECUTIONS

8.1. The Environmental Complaint Handling Procedure is shown in below **Figure 9.1**:

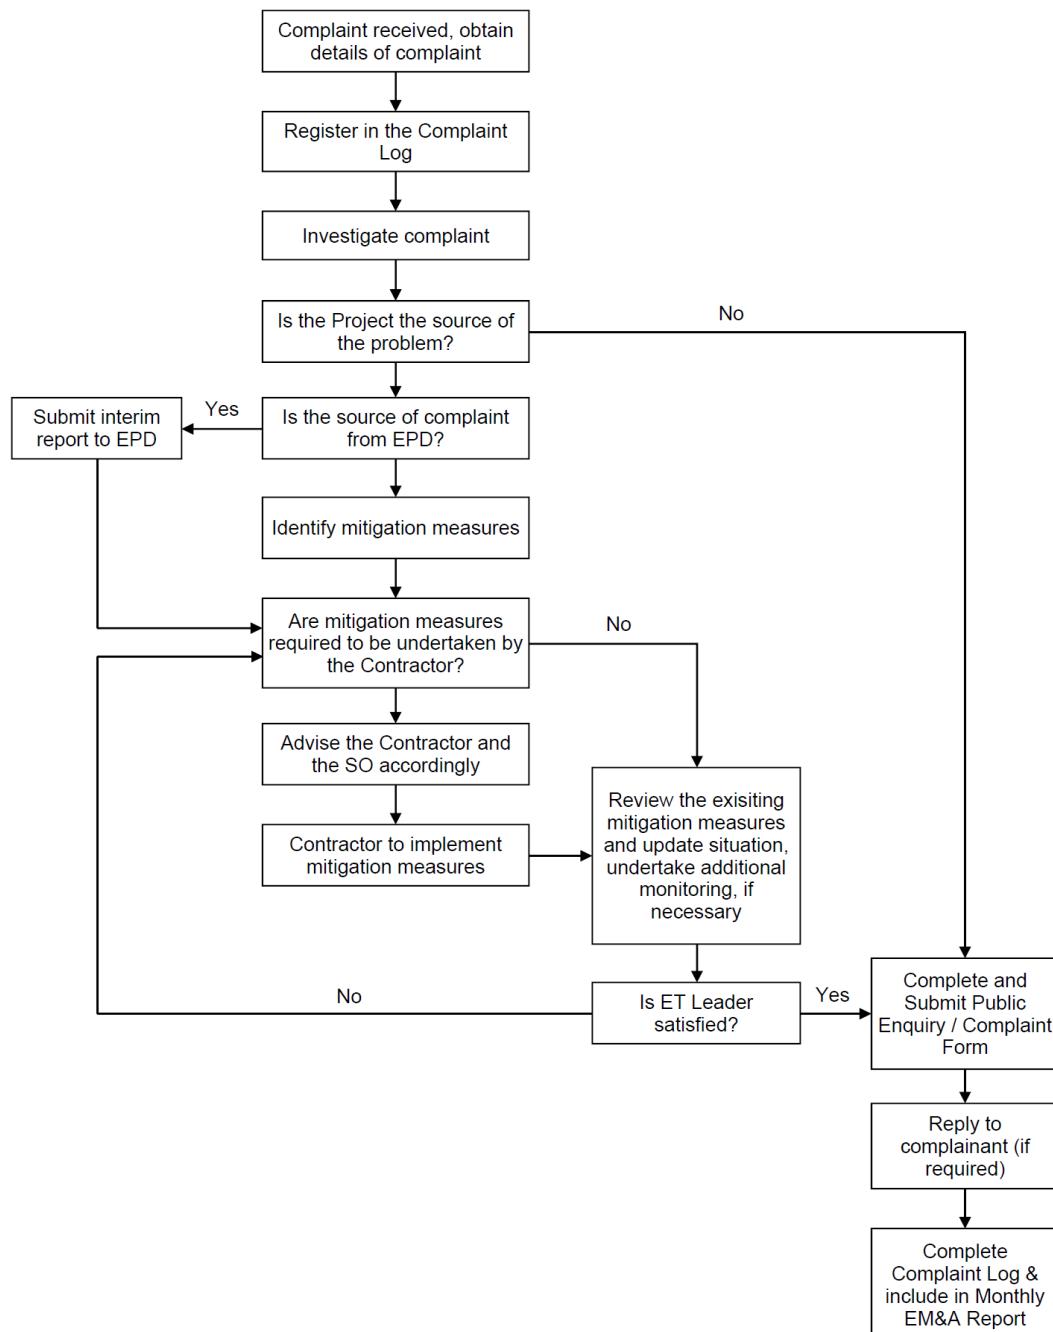


Figure 9.1 Environmental Complaint Handling Procedures

- 8.2. The first-year operation phase marine water quality monitoring was completed on 30 June 2025. No marine water quality monitoring was conducted during the reporting period.
- 8.3. Effluent Quality was conducted sampling point in the reporting month. No exceedance of the results was obtained during the reporting period.
- 8.4. No coral monitoring was conducted during the reporting period.
- 8.5. Operation phase fishery monitoring for wet season 2025 was carried out on 16 and 23 August 2025. Details of the survey report were included in the October Monthly Report.
- 8.6. No landfill gas monitoring was conducted during the reporting period.
- 8.7. No environmental complaint, notification of summons and prosecution Statistics on complaint and notification of summons and prosecution are summarized in **Appendix J**.

9. EM&A SITE INSPECTION

- 9.1. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th years, site inspection will be conducted on a bi-weekly basis starting from 15 August 2025.
- 9.2. Site inspections were carried out to monitor the implementation of proper environmental pollution control and mitigation measures under the Contract. In the reporting period, site inspections were carried out on 11, and 22 December 2025 at the site portions listed in **Table 9.1** below.

Table 9.1 Summaries of Site Inspection Record

| Date | Inspected Site Portion | Time |
|------------------|------------------------|---------------|
| 11 December 2025 | TKO Area 137 | 14:30 – 15:30 |
| 22 December 2025 | TKO Area 137 | 09:30 – 10:30 |

- 9.3. Joint site inspections with IEC were carried out on 22 December 2025.
- 9.4. No Environmental deficiencies were observed during site inspection. The site inspections during the reporting period are summarized in **Table 9.2**.

Table 9.2 Site Observations

| Date | Environmental Observations | Follow-up Status |
|------------------|---|------------------|
| 11 December 2025 | No major environmental deficiency was observed. | N/A |
| 22 December 2025 | No major environmental deficiency was observed. | N/A |

- 9.5. According to the EIA Study Report, Environmental Permit, contract documents and EM&A Manual, the mitigation measures detailed in the documents should be implemented as much as practical during the reporting period. An updated Implementation Status of Environmental Mitigation Measures (EMIS) is provided in **Appendix B**. Site inspection proforma of the reporting period is provided in **Appendix I**.

10. FUTURE KEY ISSUES

10.1. Works to be undertaken in the next reporting month are:

- Potable Water Production

10.2. The major environmental impacts brought by the above operation works include:

- Effluent of the water production work and system cleaning works;
- Waste generation from the operation activities

10.3. The key environmental mitigation measures implemented for the Contract in this reporting period associated with the above operation works include:

- Regularly monitoring of the effluent
- Sorting and storage of general refuse and operation waste

11. CONCLUSIONS AND RECOMMENDATIONS

- 11.1. This is the 18th Monthly EM&A Report for the Project which summarizes the key findings of the EM&A programme during the reporting period from 1 December to 31 December 2025, in accordance with the EM&A Manual and the requirement under FEP-01/503/2015/B.
- 11.2. The first-year operation phase marine water quality monitoring was completed on 30 June 2025. No marine water quality monitoring was conducted during the reporting period.
- 11.3. Effluent Quality was conducted sampling point in the reporting month. No exceedance of the results was obtained during the reporting period.
- 11.4. No coral monitoring was conducted during the reporting period.
- 11.5. Operation phase fishery monitoring for wet season 2025 was carried out on 16 and 23 August 2025. Details of the survey report were included in the October Monthly Report.
- 11.6. No landfill gas monitoring was conducted during the reporting period.
- 11.7. Environmental site inspections were conducted during the reporting period. Observations and reminders were reported during the site inspections. All items are rectified within the reporting period. The environmental performance of the project was therefore considered satisfactory.
- 11.8. No environmental complaints, notification of summons and prosecution was received in the reporting period.
- 11.9. The ET will keep track on the operation works to confirm compliance of environmental requirements and the proper implementation of all necessary mitigation measures.

Appendix A


Overview of Desalination Plant in Tseung Kwan O

LEGEND:

- Boundary of Senv Landfill Extension
- Boundary of Works Area for TKO Desalination Plant
- Site Phasing
- Allocated Land Boundaries

NOTE:

TEMPORARY WORKS AREA 1 WILL BE
HANDED OVER AT +6 MPD WITH A
TOLERANCE OF $\pm 500\text{mm}$.

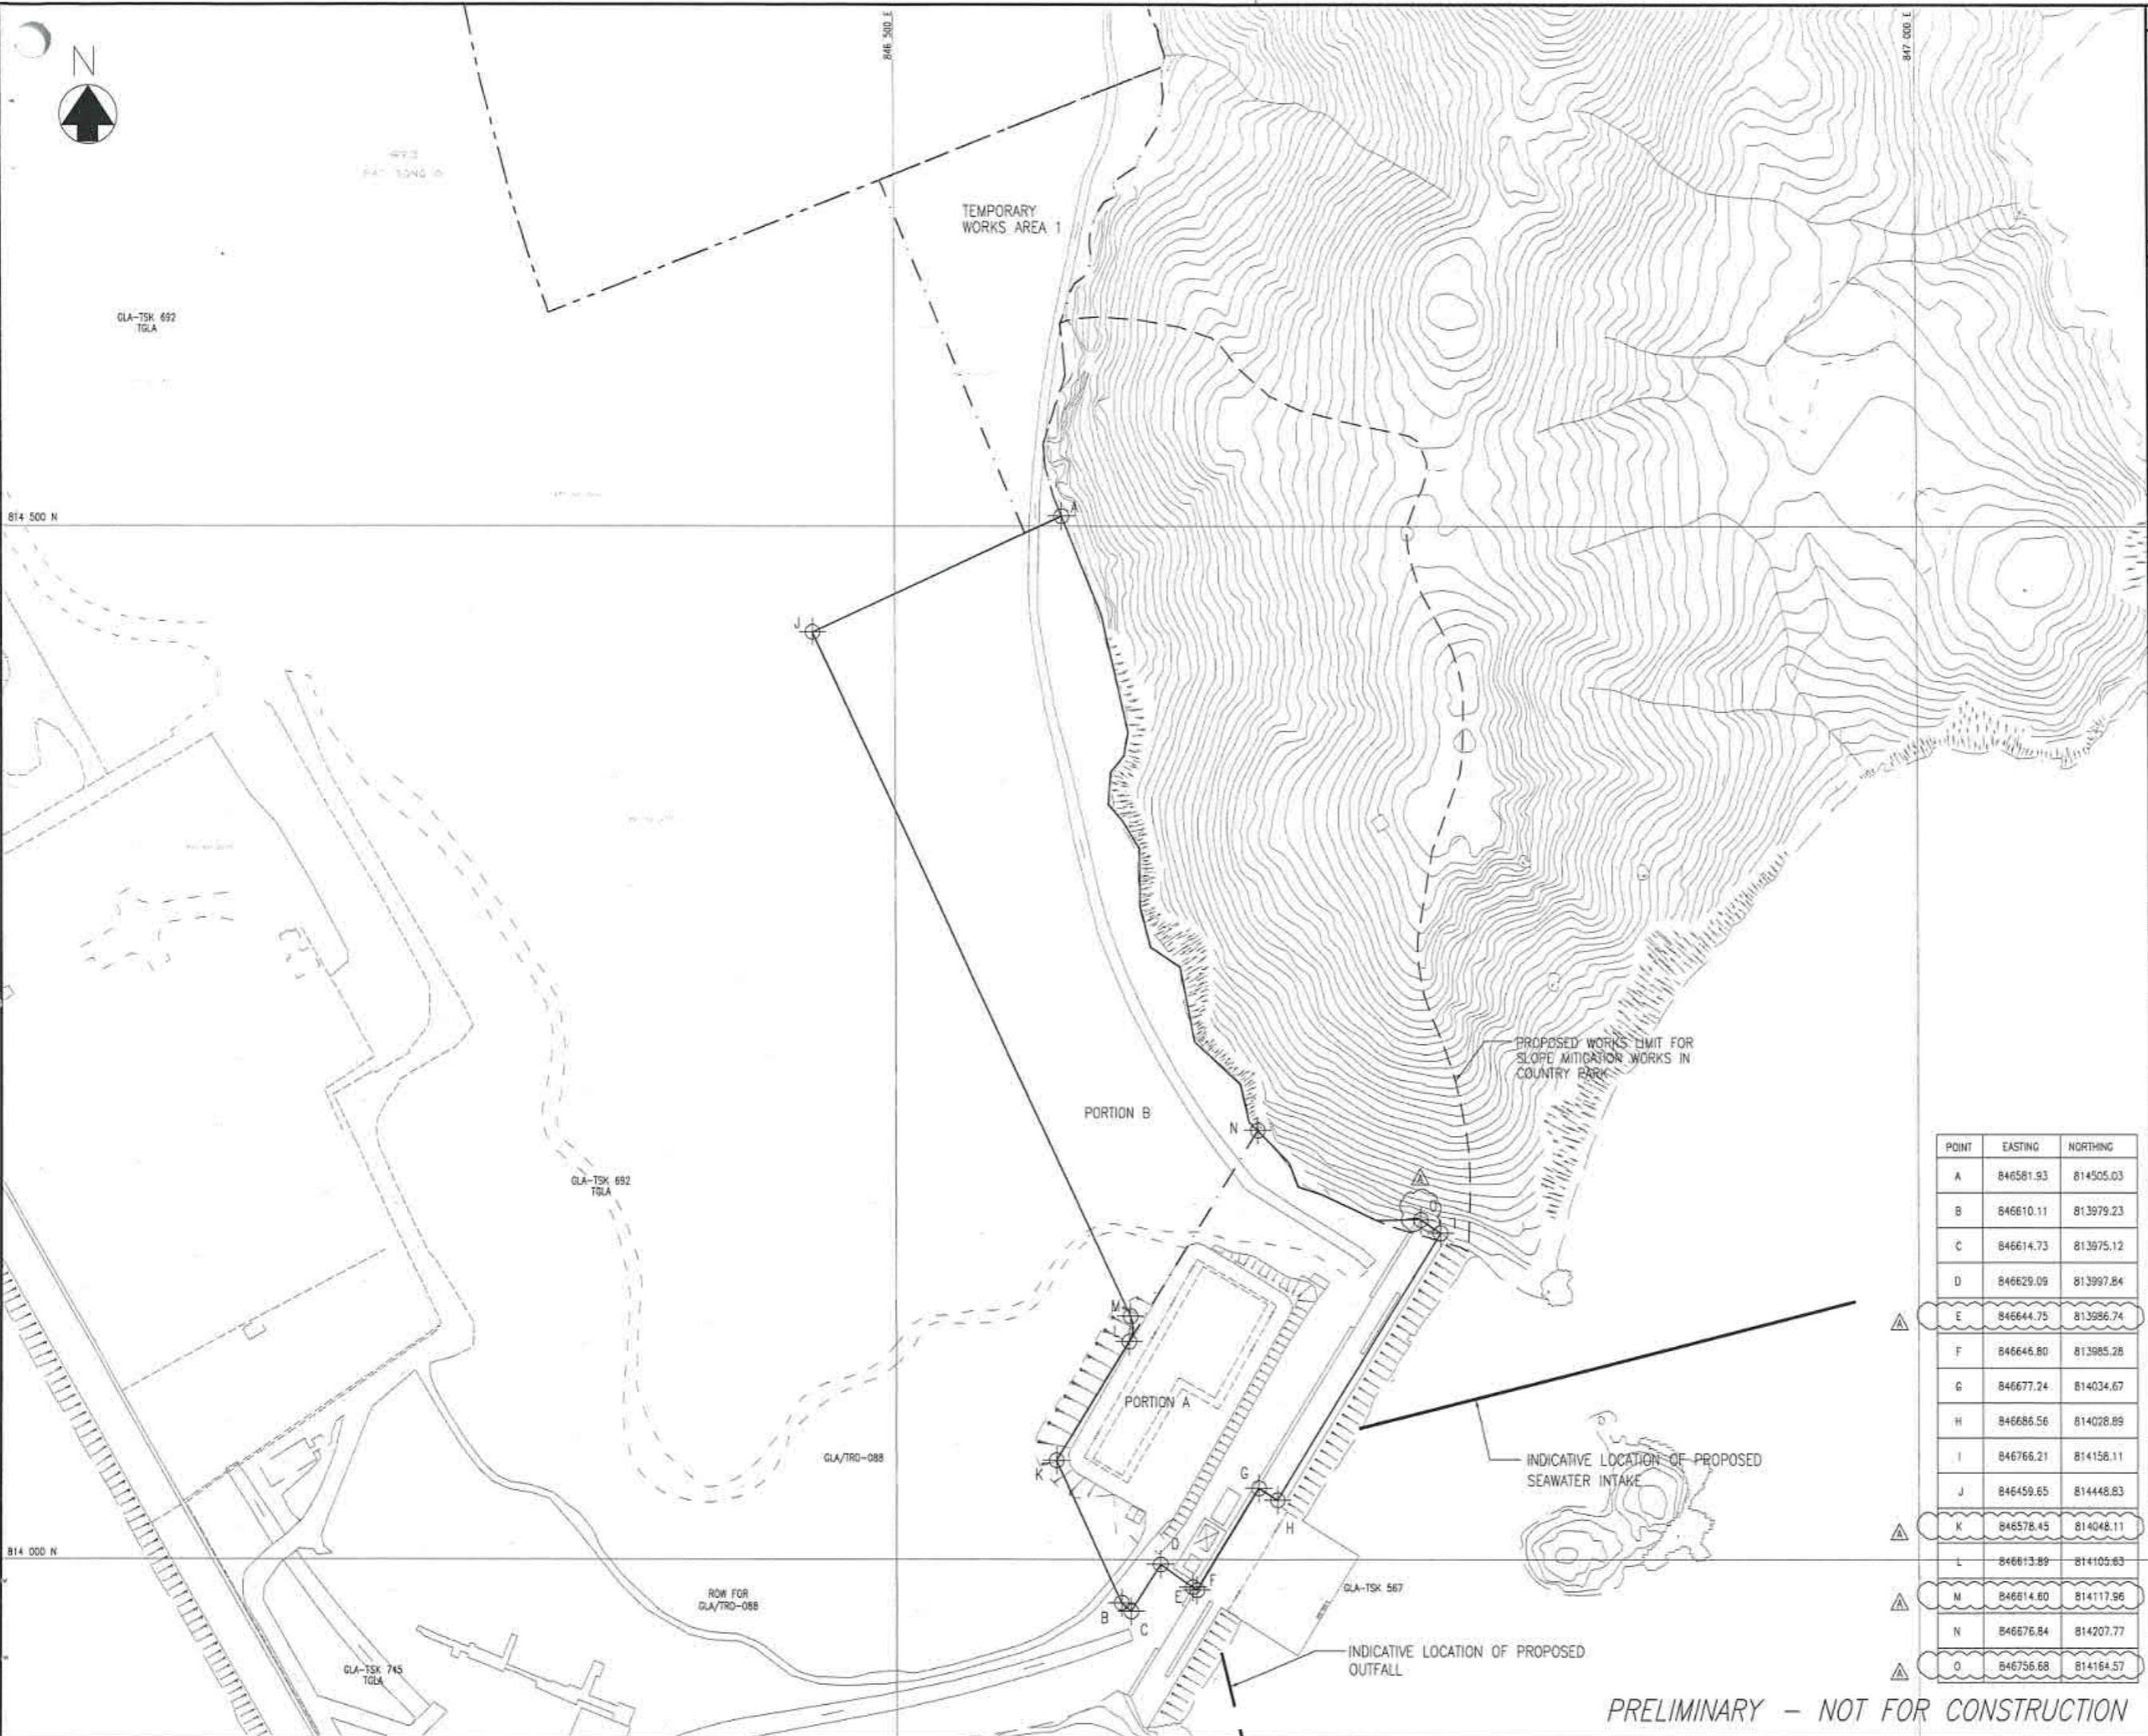

PRELIMINARY - NOT FOR CONSTRUCTION

| | | | |
|----------|----------|--------------------|---------|
| B | 10/03 | UPDATE NOTES | YLC |
| A | 07/18 | UPDATE COORDINATES | YLC |
| Revision | Date | Description | Initial |
| Initial | Designed | Checked | Drawn |
| Initial | YLC | CKH | SZ |
| Date | 02/18 | 02/18 | 02/18 |
| Approved | | | |

Christina LGO

Agreement No.: CE 8/2015 (WS)

Contract No.: 13/WSD/17

Contract Title: DESIGN, BUILD AND OPERATE FIRST STAGE OF TSEUNG KWAN O DESALINATION PLANT

Drawing Title: SITE HANDOVER WORKS AREAS

| POINT | EASTING | NORTHERN |
|-------|-----------|-----------|
| A | 846581.93 | 814505.03 |
| B | 846610.11 | 813979.23 |
| C | 846614.73 | 813975.12 |
| D | 846629.09 | 813997.84 |
| E | 846644.75 | 813986.74 |
| F | 846646.80 | 813985.26 |
| G | 846677.24 | 814034.67 |
| H | 846686.56 | 814028.89 |
| I | 846766.21 | 814158.11 |
| J | 846459.65 | 814448.83 |
| K | 846578.45 | 814048.11 |
| L | 846613.89 | 814105.63 |
| M | 846614.60 | 814117.96 |
| N | 846676.84 | 814207.77 |
| O | 846756.68 | 814164.57 |

Drawing No.: 190495/K/TEND/10/0003 Revision B

Scale: A1 1 : 1500 AJ 1 : 3000

 水務署
Water Supplies
Department

 BLACK & VEATCH HONG KONG LIMITED
博威工程顧問有限公司

BUILDINGS IN FIRST STAGE


| CODE | NAME OF BUILDING | TOTAL G.F.A. (m ²) | SITE COVERAGE (m ²) |
|---------|--|--------------------------------|---------------------------------|
| B | COMBINE SHAFT | 759,876 | 759,876 |
| C | ACTIDAFF | 10027,547 | 5455,346 |
| G | REVERSE OSMOSIS BUILDING AND ELECTRICAL BUILDING | 4511,455 | 5367,935 |
| H | CO ₂ TANKS AREA | - | - |
| J | PRODUCT WATER STORAGE TANK, PUMP STATION AND ELECTRICAL BUILDING | 1974,610 | 2933,980 |
| K | SLUDGE TREATMENT BUILDING, TANK AND PUMP ROOM | 2531,044 | 1228,361 |
| M | ADMINISTRATION BUILDING & ELECTRICAL BUILDING C | 2458,713 | 1114,062 |
| N | MAIN ELECTRICAL AND CENTRAL CHILLER PLANT BUILDING | - | 459,893 |
| R1 | ELECTROCHLORINATION BUILDING & ELECTRICAL BUILDING A | 657,992 | 825,776 |
| S | 132 KV SUBSTATION | - | 943,560 |
| T | IRRIGATION WATER TANK AND PUMP ROOM | - | 156,148 |
| R2 | CHEMICAL BUILDING | 813,056 | 813,056 |
| V | VISITOR GALLERY | 1330,410 | 1330,410 |
| X1 | GUARD HOUSE AND FS CONTROL ROOM | 39,585 | 39,585 |
| X2 | GUARD HOUSE | 22,035 | 22,035 |
| Y | R + D OUTDOOR | - | - |
| Z | WASTE WATER TREATMENT PLANT | 48,000 | 48,000 |
| TOTAL = | | 25175,323 | 21498,023 |

LEGEND / ABBREVIATION

| | |
|-----------|---|
| HL WINDOW | HIGH LEVEL WINDOW |
| M.L. | METAL LOUVRES |
| C.L. | CAT LADDER |
| A.U.T. | ACCESSIBLE UNISEX TOILET |
| ◆◆◆ | PROPOSED FINISH FLOOR LEVEL IN METER ABOVE P.D. |
| ◆◆◆ | STRUCTURAL FLOOR LEVEL IN METER ABOVE P.D. |
| M.V.A.L | MECHANICAL VENTILATION & ARTIFICIAL LIGHTING |
| F.E. | 4.5kg CO ₂ FIRE EXTINGUISHER |
| H.R. | HOSE REEL |
| Ⓐ | FIREMAN'S LIFT |
| Ⓑ | LIFT FOR THE BARRIER FREE ACCESS |
| P.D. | PIPE DUCT |


SITE LOCATION PLAN

1 : 5000

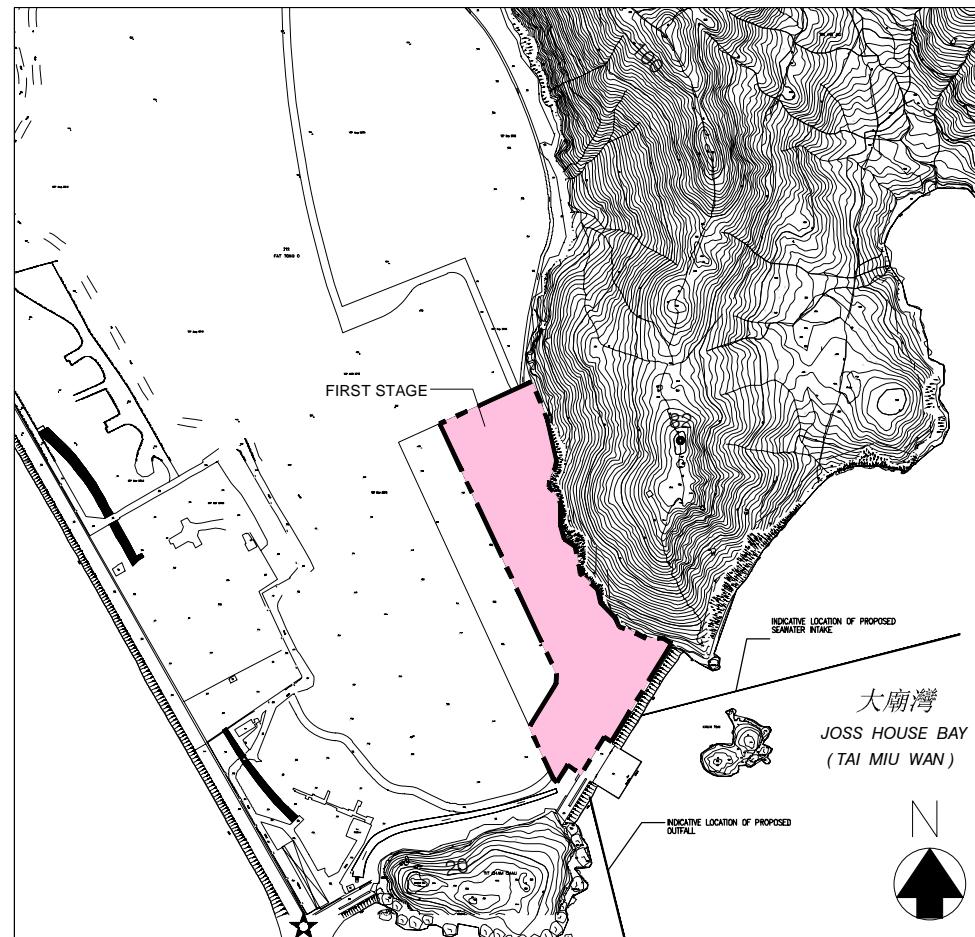

FIRST STAGE OF TSEUNG KWAN O DESALINATION PLANT

1 : 1000

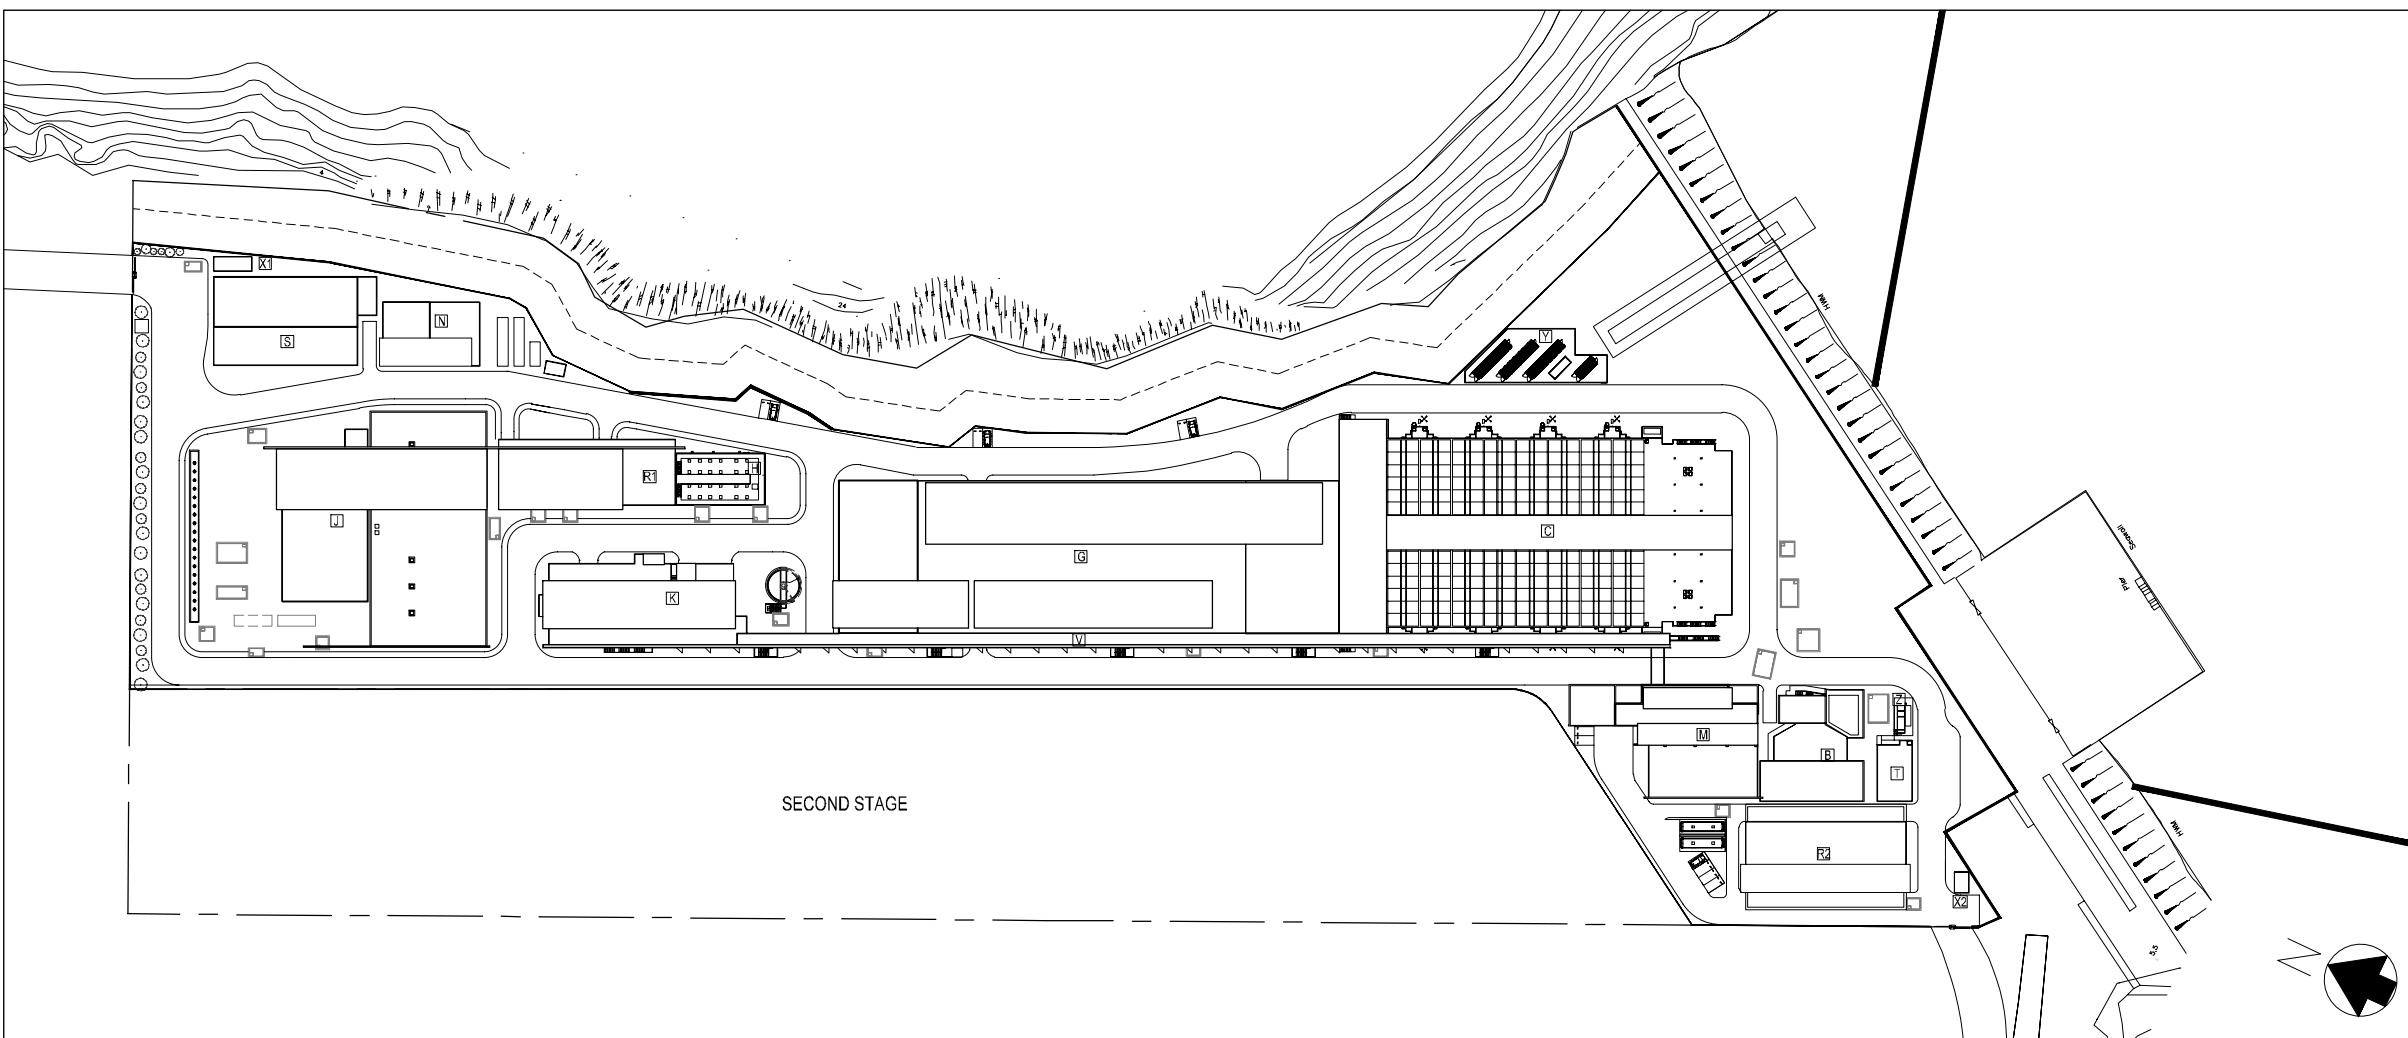

| | | | |
|--|-------------------|---------|----------|
| 0 | TENDER SUBMISSION | CAD | JAN 19 |
| Rev | Description | By | Date |
| Employer | | | |
|  水務署 Water Supplies Department | | | |
| Employer's Consultant | | | |
|  BLACK & VEATCH | | | |
| Tenderer | | | |
|  Acciona JEC AJC JOINT VENTURE | | | |
| Designer | | | |
|  WSP | | | |
| Project title | | | |
| CONTRACT NO. 13/WSD/17 | | | |
| DESIGN, BUILD AND OPERATE | | | |
| FIRST STAGE OF TSEUNG KWAN O | | | |
| DESALINATION PLANT | | | |
| Drawing title | | | |
| ARCHITECTURAL – | | | |
| PLOT RATIO AND SITE COVERAGE | | | |
| CALCULATION, LEGEND | | | |
| ABBREVIATION | | | |
| Drawing no. | | Rev. | |
| TKO/AJC/W/A000/AR/001 | | 0 | |
| Drawn | Date | Checked | Approved |
| CKAL | JAN 19 | S.C. | T.C. |
| Scale | N.T.S. | Status | — |

©COPYRIGHT RESERVED

Appendix B

Summary of Implementation Status of Environmental Mitigation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|-------------------------|--|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| Air Quality | | | | | | | | |
| S4.8.1 | Ultra-low-sulphur diesel (ULSD) will be used for all construction plant on-site, as defined as diesel fuel containing not more than 0.005% sulphur by weight as stipulated in Environment, Transport and Works Bureau Technical Circular (ETWB-TC(W)) No 19/2005 on Environmental Management on Construction Sites. | Land site/ During construction/ During Operation | Contractor(s) | | ✓ | ✓ | Implemented | Environment, Transport and Works Bureau Technical Circular (ETWB- TC(W)) No 19/2005 on Environmental Management on Construction Sites |
| Water Quality | | | | | | | | |
| S6.9 and S6.12 | The sterilization water should be dechlorinated with total residual chlorine (TRC) level below 1 mg/L before discharge to public sewer. In situ testing of TRC should also be conducted for the discharge of chlorinated water for pipeline disinfection to ensure sufficient dechlorination before discharge to public sewer. | Sterilization of water mains prior to commissioning | Contractor(s) | | ✓ | ✓ | Implemented | Technical Memorandum for Effluents Discharged into Drainage and Sewerage Systems Inland and Coastal Waters |
| S6.9 | The cleaning and flushing water should also be treated and desilted to the relevant discharge requirement stipulated in TM-DSS before discharging. | Sterilization of water mains prior to commissioning | Contractor(s) | | ✓ | ✓ | Implemented | |
| S6.9 | Site drainage should be well maintained, and good construction practices should be observed to ensure that oil, fuels, solvents, and other chemicals are managed, stored and handled properly and do not enter the nearby water streams. | Land site & drainage/ During construction/ During operation | Contractor(s) | | ✓ | ✓ | Implemented | - |
| Waste Management | | | | | | | | |
| S8.5 | Provision of sufficient waste disposal points and regular collection for disposal. | All area/ During construction/ During operation | Contractor(s) | | ✓ | ✓ | Implemented | DEVB TC(W) No. 8/2010, Enhanced Specification for Site Cleanliness and Tidiness. |
| S8.5 | Chemical waste container shall be suitable for the substance they are holding, resistant to corrosion, maintained in a good condition, and securely closed. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | Waste Disposal (Chemical Waste) (General) Regulation; Code of Practice on the Packaging, Handling and Storage of Chemical Wastes |
| S8.5 | Chemical waste container shall have a capacity of less than 450 L unless the specifications have been approved by the EPD. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | A label in English and Chinese shall be displayed on the chemical container in accordance with instructions prescribed in Schedule 2 of the Regulations. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|-------------------------------|--|---|----------------------|----------------------|---|---|----------------------------|---|
| | | | | D | C | O | | |
| S8.5 | Storage areas for chemical waste shall be enclosed on at least 3 sides. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | DEVB TC(W) No. 8/2010 Enhanced Specification for Site Cleanliness and Tidiness. |
| S8.5 | Storage areas for chemical waste shall have an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or 20% by volume of the chemical waste stored in that area, whichever is the greatest. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | Storage areas for chemical waste shall have adequate ventilation. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | Storage areas for chemical waste shall be covered to prevent rainfall entering (water collected within the bund must be tested and disposed of as chemical waste, if necessary). | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | Storage areas for chemical waste shall be arranged so that incompatible materials are appropriately separated. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | General refuse will be stored in enclosed bins or compaction units separately from construction and chemical wastes. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented after reminder | |
| S8.5 | Adequate number of waste containers will be provided to avoid over-spillage of waste. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | A reputable waste collector will be employed by the Contractor to remove general refuse from the site, separately from construction and chemical wastes, on a daily basis to minimize odour, pest and litter impacts. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | |
| S8.5 | Recycling bins will be provided at strategic locations within the Site to facilitate recovery of recyclable materials (including aluminum can, wastepaper, glass bottles and plastic bottles) from the Site. Materials recovered will be sold for recycling. | All area/ During construction/ During operation | Contractor(s)/ WSD | ✓ | ✓ | | Implemented | - |
| Landscape & Visual | | | | | | | | |
| S11.10 & 11.11 | The construction area and area allowed for temporary structures, such as the contractor's office, will be minimized to a practical minimum. (MM1) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|----------------|--|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| S11.10 & 11.11 | At the detailed design stage, the design team will seek to minimize the landscape footprint of the Project and above ground facilities, while satisfying all other requirements. (MM2) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S11.10 & 11.11 | Design principles will be adopted to take into account the surrounding area, particularly Clear Water Bay Country Park behind and the nearby waterfront, with due consideration given to: <ul style="list-style-type: none"> - green roofs where practical (i.e. without equipment on the roof); - roadside planting; - aesthetic treatment of all structures; - vertical greening; - screen planting along application site; and - landscape enhancement with amenity planting where practical including planting along the edge (site boundary) fence with native shrubs where feasible, to reduce their visual impact and blend them into the surrounding landscape. (MM3) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S11.10 & 11.11 | All trees within the Project Site or the potential slope mitigation works area will be carefully protected during construction according to DEVB TCW No. 10/2013 – Tree Preservation (MM4) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | ETWB TCW No. 3/2006 - Tree Preservation. |
| S11.10 & 11.11 | No tree within the Country Park will be felled. Trees within the Site unavoidably affected by the works will be transplanted where necessary and practical. For trees that need to be felled, compensatory planting will be provided to the satisfaction of relevant Government departments. A compensatory tree planting proposal including locations of tree compensation will be submitted to seek relevant government department's approval, in accordance with DEVB TC(W) No. 10/2013. (MM5) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | DEVB TC(W) No. 10/2013 |
| S11.10 & 11.11 | Any slope mitigation works necessary to address natural terrain hazards, will be minimized to minimize any potential environmental impact to the Country Park e.g. soil nailing and rock stabilization will aim to avoid existing trees e.g. should any restoration of vegetation be necessary, the best planting matrix with native species will be established, with the aim of resembling the existing vegetation. (MM6) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S11.10 & 11.11 | Dredging works for the installation of intake structures and outfall diffusers should be minimized to avoid or reduce any potential environmental impacts to as low as reasonably practicable (ALARP). The intake and outfall structures (e.g. intake openings and diffuser heads) will be prefabricated and transferred to site for | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|----------------------------|--|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| | installation. (MM7) | | | | | | | |
| S11.10 & 11.11 | All night-time lighting will be reduced to a practical minimum both in terms of number of level and will be hooded and directional. (MM8) units and lux level and will be hooded and directional. (MM8) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| Landfill Gas Hazard | | | | | | | | |
| S12.7 | During all works, safety procedures should be implemented to minimize the risks of fires and explosions, asphyxiation of workers and toxicity effects resulting from contact with contaminated soil and groundwater. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S12.7 | During trenching and excavation as well as creation of confined spaces at near to or below ground level, precautions should be clearly laid down and rigidly Gas detection equipment and appropriate breathing apparatus should be available and used when entering confined spaces or trenches deeper than 1 meter. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | The Contractor should make the workers are aware of potential hazards of working in confined spaces (any chamber, manhole or culvert which is large enough to permit access to personnel). Such work in confined spaces is controlled by the Factories and Industrial Undertakings (Confined Spaces) Regulations of the Factories and Industrial Undertakings Ordinance. Following the Safety Guide to Working in Confined Spaces ensures compliance with the above regulations. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Safety officers, specifically trained with regard to landfill gas and leachate related hazards and the appropriate actions to take in adverse circumstances, should be present on the site throughout the works, in particular, when works are undertaken below grade. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | All personnel who work on site and all visitors to the site should be made aware of the possibility of ignition of gas in the vicinity of the works, the possible presence of contaminated water and the need to avoid physical contact with it. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Monitoring for landfill gas should be undertaken in all excavations, manholes, chambers (particularly during pipe jacking) and any confined spaces through the use of an intrinsically safe portable instrument, appropriately calibrated and capable of measuring the concentrations of methane, carbon dioxide and oxygen. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Monitoring frequency and areas to be monitored should be specified prior to commencement of groundwork, either by the Safety Officer, or by an appropriately qualified person. All measurements should be recorded and documented. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|---------------|---|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| S12.7 | Proceed drilling with adequate care and precautions against the potential hazards which may be encountered. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Prior to the commencement of the site works, the drilling contractor should devise a 'method-of- working' statement covering all normal and emergency procedures (including but not limited to number of operatives, experience and special skills of operatives, normal method of operations, emergency procedures, <i>supervisors</i> responsibilities, storage and use of safety equipment, safety procedures and signs, barriers and guarding). The site <i>supervisor</i> and all operatives must be familiar with this statement. | All area/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Where below ground service entries are necessary to the Incoming Switchgear Room, 132 kV Substation and Chlorine Store (I) and (II), the entry point should be sealed to prevent gas entry. In addition, any below grade cable trenches entering the Incoming Switchgear Room and 132 kV Substation can become the pathway for landfill gas and hence gridded metal covers should be used. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | It is recommended regular landfill gas monitoring should be carried out at the Incoming Switchgear Room, 132 kV Substation and Chlorine Store (I) and (II). The monitoring frequency will be monthly for the first year of operation. If the monitoring results show no sign of landfill gas migration, reduce the monitoring frequency to once every six months. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | The manholes and utility pits within the Project Site and along the fresh water mains. Each manhole/ utility pit should be monitored with two measurements (at mid depth and base). Each measurement should be monitored for a minimum of 10 minutes. A steady reading and peak reading should be recorded at each manhole/ utility pit and for each measurement. The need for venting the manhole/ utility pit and further monitoring will be reviewed after the initial monitoring. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | All construction, operation and maintenance personnel working on-site as well as visitors should be made aware of the hazards of landfill gas and its possible presence on-site. This should be achieved through a combination of posting warning signs in prominent places and also by access to detailed information on landfill gas hazards and the designs and procedural means by which these hazards are being minimized on-site. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

Note: D – Design stage C – Construction O – Operation

Appendix C

Impact Monitoring Schedule

2nd Year Operation Monitoring Programme

| Monitoring | Jul-25 | Aug-25 | Sep-25 | Oct-25 | Nov-25 | Dec-25 | Jan-26 | Feb-26 | Mar-26 | Apr-26 | May-26 | Jun-26 |
|---------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Effluent Quality⁽²⁾ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Landfill Gas⁽³⁾ | ✓ | ✓ | | | | | | ✓ | | | | |
| Coral⁽⁴⁾ | ✓ | ✓ | | | ✓ | | | ✓ | | | ✓ | |
| Fishery⁽⁵⁾ | | ✓ | | | | | | ✓ | | | | |

Remark:

- (1) A proposal to change the operation phase EM&A programme was submitted to the EPD on 11 August 2025 and approved by the EPD on 15 August 2025.
- (2) In accordance with the discharge license, in-situ effluent quality monitoring will be conducted on a weekly basis and laboratory measurement will be conducted on a monthly basis.
- (3) Landfill gas monitoring will be conducted on a six-month basis.
- (4) Coral monitoring will be conducted on a quarterly basis.
- (5) Fishery monitoring will be conducted two times in wet season and two times in dry season in an annual basis.

Contract No. 13/WSD/17
Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant
Tentative Landfill Gas Monitoring Schedule (February 2026)

| Sun | Mon | Tue | Wed | Thu | Fri | Sat |
|-----|-----|-----|-------------------------|-------------------------|-----|-----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 |
| 8 | 9 | 10 | 11 | 12 | 13 | 14 |
| | | | Landfill Gas Monitoring | Landfill Gas Monitoring | | |
| 15 | 16 | 17 | 18 | 19 | 20 | 21 |
| 22 | 23 | 24 | 25 | 26 | 27 | 28 |
| | | | | | | |

Remarks:
1. Monitoring Parameters: Oxygen, Methane, Carbon Dioxide and Barometric Pressure
2. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th years, landfill gas will be conducted on a every six month basis starting from August 2025.

Contract No. 13/WSD/17
Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant
Tentative Ecological Monitoring Schedule

| Feb-26 | | | | | | |
|--------------------|-----|-----|------------------|-----|-----|--------------------|
| Sun | Mon | Tue | Wed | Thu | Fri | Sat |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 |
| | | | | | | Fishery Monitoring |
| 8 | 9 | 10 | 11 | 12 | 13 | 14 |
| | | | Coral Monitoring | | | |
| 15 | 16 | 17 | 18 | 19 | 20 | 21 |
| | | | | | | |
| 22 | 23 | 24 | 25 | 26 | 27 | 28 |
| | | | | | | |
| 1 Mar | 2 | 3 | 4 | 5 | 6 | 7 |
| | | | | | | |
| Fishery Monitoring | | | | | | |

1. The schedule may change due to unforeseen circumstances (adverse weather, etc.)
 2. According to the approved proposal to change the operation phase EM&A programme for the 2nd to 10th years, coral monitoring will be conducted on a quarterly basis starting from August 2025.

Appendix D

Event / Action Plan

Table D2 Event and Action Plan for Ecology during Operation Phase

| Event | ET | IEC | Action | | | |
|--------------------------------|--|---|--|---|--|--|
| | | | Contractor(s) | ER | | |
| Non-conformity on one occasion | <ol style="list-style-type: none"> Identify source Inform IEC and ER Discuss remedial actions with IEC, the ER and the Contractor Monitor/ audit/ review remedial actions until rectification has been completed | <ol style="list-style-type: none"> Check monitoring/ auditing results Check the Contractor's working method Discuss with the ET and Contractor on possible remedial measures Advise the ER on effectiveness of proposed remedial measures Check the implementation of remedial measures | <ol style="list-style-type: none"> Take immediate action to avoid further problem Amend working methods if needed Submit proposals for remedial actions to ET, ER and IEC Rectify damage and implement the agreed remedial actions | <ol style="list-style-type: none"> Notify Contractor Ensure remedial measures are properly implemented Consider and instruct, if necessary, the Contractor to slow down or to stop all or part of the works in case of serious non-conformity until situation is rectified | | |
| Repeated Non-conformity | <ol style="list-style-type: none"> Identify source Inform IEC, ER, EPD and AFCD Increase monitoring and audit frequency Discuss remedial actions with the IEC, the ER and the Contractor Monitor/ audit/ review remedial actions until rectification has been completed If non-conformity stops, cease additional monitoring/ auditing | <ol style="list-style-type: none"> Check monitoring/ auditing results Check the Contractor's working method Discuss with the ET and Contractor on possible remedial measures Supervise the implementation of remedial measures Advise the ER on effectiveness of proposed remedial measures and keep EPD and AFCD informed | <ol style="list-style-type: none"> Take immediate action to avoid further problem Amend working methods if needed Submit proposals for remedial actions to ET, ER and IEC Rectify damage and implement the agreed remedial actions | <ol style="list-style-type: none"> Notify Contractor Ensure remedial measures are properly implemented Consider and instruct, if necessary, the Contractor to slow down or to stop all or part of the works in the case of serious non-conformity until situation is rectified | | |

Notes : ET = Environmental Team, IEC = Independent Environmental Checker; ER = Engineering Representatives

Table D3 Event and Action Plan for Operation Phase Coral Monitoring

| Event | Action | | | |
|-------------------------|--|---|---|--|
| | ET Leader | IEC | SOR ** | Contractor |
| Action Level Exceedance | <ol style="list-style-type: none"> 1. Check monitoring data 2. Inform the IEC, SOR and Contractor of the findings; 3. Increase the monitoring to at least once a month to confirm findings; 4. Propose mitigation measures for consideration | <ol style="list-style-type: none"> 1. Discuss monitoring with the ET and the Contractor; 2. Review proposals for additional monitoring and any other measures submitted by the Contractor and advise the SOR accordingly. | <ol style="list-style-type: none"> 1. Discuss with the IEC additional monitoring requirements and any other measures proposed by the ET; 2. Make agreement on the measures to be implemented. | <ol style="list-style-type: none"> 1. Inform the SOR and confirm notification of the non-compliance in writing; 2. Discuss with the ET and the IEC and propose measures to the IEC and the SOR; 3. Implement the agreed measures. |
| Limit Level Exceedance | <ol style="list-style-type: none"> 1. Undertake Steps 1-4 as in the Action Level Exceedance. If further exceedance of Limit Level, propose enhancement measures for consideration. | <ol style="list-style-type: none"> 1. Discuss monitoring with the ET and the Contractor; 2. Review proposals for additional monitoring and any other measures submitted by the Contractor and advise the SOR accordingly. | <ol style="list-style-type: none"> 1. Discuss with the IEC additional monitoring requirements and any other measures proposed by the ET; 2. Make agreement on the measures to be implemented. | <ol style="list-style-type: none"> 1. Inform the SOR and confirm notification of the non-compliance in writing; 2. Discuss with the ET and the IEC and propose measures to the IEC and the SOR; 3. Implement the agreed measures. |

Remark: ** The "SOR" is equivalent to the "ER" as defined in the EM&A Manual of the Project

Table D4 Event and Action Plan for Operation Phase LFG Hazard

| Parameters | Level | Action |
|-----------------------------------|------------------------------------|--|
| Oxygen (O ₂) | Action Level < 19% O ₂ | Ventilate trench/void to restore O ₂ to > 19% Stop works Evacuate personnel/prohibit entry Increase ventilation to restore O ₂ to > 19% |
| | Limit Level < 19% O ₂ | |
| Methane (CH ₄) | Action Level >10% LEL | Post "No Smoking" signs Prohibit hot works Increase ventilation to restore CH ₄ to <10% LEL |
| | Limit Level >20% LEL | Stop works Evacuate personnel/prohibit entry Increase ventilation to restore CH ₄ to <10% LEL |
| Carbon Dioxide (CO ₂) | Action Level >0.5% CO ₂ | Ventilate to restore CO ₂ to < 0.5% |
| | Limit Level >1.5% CO ₂ | Stop works Evacuate personnel / prohibit entry Increase ventilation to restore CO ₂ to <0.5% |

Appendix E

Landfill Gas Equipment Calibration Certification (Not Used)

Appendix F

Landfill Gas Monitoring Data (Not Used)

Appendix H

Ecology Survey Report (Not Used)

Appendix G

Waste Flow Table

Monthly Summary Waste Flow Table for 2025 (year)

| Month | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|-----------|--|-------------------------------------|------------------------|--------------------------|-------------------------|---------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| | Total Quantity Generated | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 3) | Chemical Waste | Others, e.g. general refuse |
| | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) |
| Jan | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 38.740 |
| Feb | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 18.330 |
| Mar | 30.520 | 0.000 | 0.000 | 0.000 | 30.520 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 29.050 |
| Apr | 21.290 | 0.000 | 0.000 | 0.000 | 21.290 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 73.450 |
| May | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 35.720 |
| Jun | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 28.950 |
| Sub-total | 51.810 | 0.000 | 0.000 | 0.000 | 51.810 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 224.240 |
| Jul | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 1.434 | 13.330 |
| Aug | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 27.340 |
| Sep | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 |
| Oct | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 13.710 |
| Nov | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 14.270 |
| Dec | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 70.660 |
| Total | 51.810 | 0.000 | 0.000 | 0.000 | 51.810 | 0.000 | 0.000 | 0.000 | 0.000 | 1.434 | 363.550 |

Notes:

- (1) The performance targets are given in Section 1.69 of Specification B
- (2) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (3) Plastics refer to plastic bottles/containers, plastic sheets/ foam from packaging material

Appendix I

Site Inspection Proforma



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 11/12/2025

Inspected by:

ET: Jacky Leung

SO: Image Yeung

WSD: _____

Contractor: Tommy Law

IEC: _____

Inspection Time: 14:30

| Weather | | | | | | | |
|-------------|--------------------------------|---|-----------------------------------|----------------------------------|--|--|-------------------------------|
| Condition | <input type="checkbox"/> Sunny | <input type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input checked="" type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <u>17.5</u> °C | | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low |
| Wind | <input type="checkbox"/> Calm | <input checked="" type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|-------------------------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 0.00 | General | | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.00 | Air Quality | | | | | |
| 1.01 | S4.8.2 | Is the treatment and storage of the chemical sludge enclosed inside building structure? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.02 | S4.8.2 | Is the sludge treatment equipped Forced ventilation system with sufficient air change rate? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.03 | S4.8.2 | Is the exhaust discharge directed away from ASRs as far as practicable? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.04 | S4.8.2 | Is the chemical sludge produced at the desalination plant removed off-site regularly to avoid accumulation of potentially odourous materials on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.05 | S4.8.2 | Is dewatered sludge to landfill handled and transported properly to minimise odour nuisance to nearby ASRs? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.06 | S4.8.2 | Are the trucks fully enclosed during transporting the dewatered sludge to the landfill to minimise any off-site odour impact during the transportation process? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.00 | Waste Management | | | | | |
| 2.02 | S8.5.2 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.03 | S8.5.2 | Is a trip-ticket system implemented to monitor the disposal of solid wastes at public filling facilities and landfills? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.04 | S8.5.2 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.05 | S8.5.2 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.06 | S8.5.2 | Are trip tickets for chemical waste disposal available for inspection? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.07 | S8.5.2 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.08 | S8.5.2 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.09 | S8.5.2 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|-----------------------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 2.10 | S8.5.2 | Are incompatible chemical wastes stored in different areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.11 | S8.5.2 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.12 | S8.5.2 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.13 | S8.5.2 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.14 | S8.5.2 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.15 | S8.5.2 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.16 | S8.5.2 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.17 | S8.5.2 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.18 | S8.5.2 | Is the dewatered sludge met the minimum dry solid content (30%) in the to be disposed of at landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.19 | S8.5.2 | Is a dumping license obtained to deliver public fill to public filling areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.00 | Landscape and Visual | | | | | |
| 3.01 | S11.10 & 11.11 | Are site hoarding provided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.06 | S11.10 & 11.11 | Are excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | Landfill Gas Hazard | | | | | |
| 4.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 4.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.05 | S12.7 | Are all personnel working on site and all visitors made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the gridded metal covers being used for below grade cable trenches? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for a minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.00 | | Overall | | | | |
| 5.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant


Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

Reminder

1.) Regularly check and calibrate your water quality monitoring equipment such as pH and salinity sensors.

Signatures:

ET
Representative


(Name: Lewis Chung Ho)

Contractor's
Representative


(Name: Tony Lui)

Supervising Officer's
Representative


(Name: Wong Yung)

IEC's
Representative

(Name:)

WSD's
Representative

(Name:) (Name:)



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 22/12/2025

Inspected by:

ET: Toby Wan

SO: Image Yeung

WSD: _____

Contractor: Tommy Law

IEC: Serena Shek

Inspection Time: 09:30

| Weather | | | | | | | |
|-------------|--------------------------------|---|-----------------------------------|----------------------------------|--|--|-------------------------------|
| Condition | <input type="checkbox"/> Sunny | <input type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input checked="" type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <u>22.5</u> °C | | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low |
| Wind | <input type="checkbox"/> Calm | <input checked="" type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|-------------------------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 0.00 | General | | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.00 | Air Quality | | | | | |
| 1.01 | S4.8.2 | Is the treatment and storage of the chemical sludge enclosed inside building structure? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.02 | S4.8.2 | Is the sludge treatment equipped Forced ventilation system with sufficient air change rate? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.03 | S4.8.2 | Is the exhaust discharge directed away from ASRs as far as practicable? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.04 | S4.8.2 | Is the chemical sludge produced at the desalination plant removed off-site regularly to avoid accumulation of potentially odourous materials on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.05 | S4.8.2 | Is dewatered sludge to landfill handled and transported properly to minimise odour nuisance to nearby ASRs? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.06 | S4.8.2 | Are the trucks fully enclosed during transporting the dewatered sludge to the landfill to minimise any off-site odour impact during the transportation process? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.00 | Waste Management | | | | | |
| 2.02 | S8.5.2 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.03 | S8.5.2 | Is a trip-ticket system implemented to monitor the disposal of solid wastes at public filling facilities and landfills? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.04 | S8.5.2 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.05 | S8.5.2 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.06 | S8.5.2 | Are trip tickets for chemical waste disposal available for inspection? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.07 | S8.5.2 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.08 | S8.5.2 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.09 | S8.5.2 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|-----------------------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 2.10 | S8.5.2 | Are incompatible chemical wastes stored in different areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.11 | S8.5.2 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.12 | S8.5.2 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.13 | S8.5.2 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.14 | S8.5.2 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.15 | S8.5.2 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.16 | S8.5.2 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.17 | S8.5.2 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.18 | S8.5.2 | Is the dewatered sludge met the minimum dry solid content (30%) in the to be disposed of at landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.19 | S8.5.2 | Is a dumping license obtained to deliver public fill to public filling areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.00 | Landscape and Visual | | | | | |
| 3.01 | S11.10 & 11.11 | Are site hoarding provided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.06 | S11.10 & 11.11 | Are excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | Landfill Gas Hazard | | | | | |
| 4.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 4.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.05 | S12.7 | Are the all personnel working on site and all visitor made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are the all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the gridded metal covers being used for below grade cable trenches? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.00 | | Overall | | | | |
| 5.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

Reminder :

Tree health must be maintained carefully .

Site Inspection: 22/12

Signatures:

ET
Representative

(Name: Toby Wan)

Contractor's
Representative

(Name: Tony Wu)

Supervising Officer's
Representative

(Name: Image Yung)

IEC's
Representative

(Name: Serena Shek)

WSD's
Representative

(Name:)

Appendix K

Complaint Log

Statistical Summary of Environmental Complaints

| Reporting Period | Environmental Complaint Statistics | | |
|----------------------|------------------------------------|------------|------------------|
| | Frequency | Cumulative | Complaint Nature |
| 1 – 31 December 2025 | 0 | 2 | N/A |

Statistical Summary of Environmental Summons

| Reporting Period | Environmental Summons Statistics | | |
|----------------------|----------------------------------|------------|---------|
| | Frequency | Cumulative | Details |
| 1 – 31 December 2025 | 0 | 0 | N/A |

Statistical Summary of Environmental Prosecution

| Reporting Period | Environmental Prosecution Statistics | | |
|----------------------|--------------------------------------|------------|---------|
| | Frequency | Cumulative | Details |
| 1 – 31 December 2025 | 0 | 0 | N/A |